



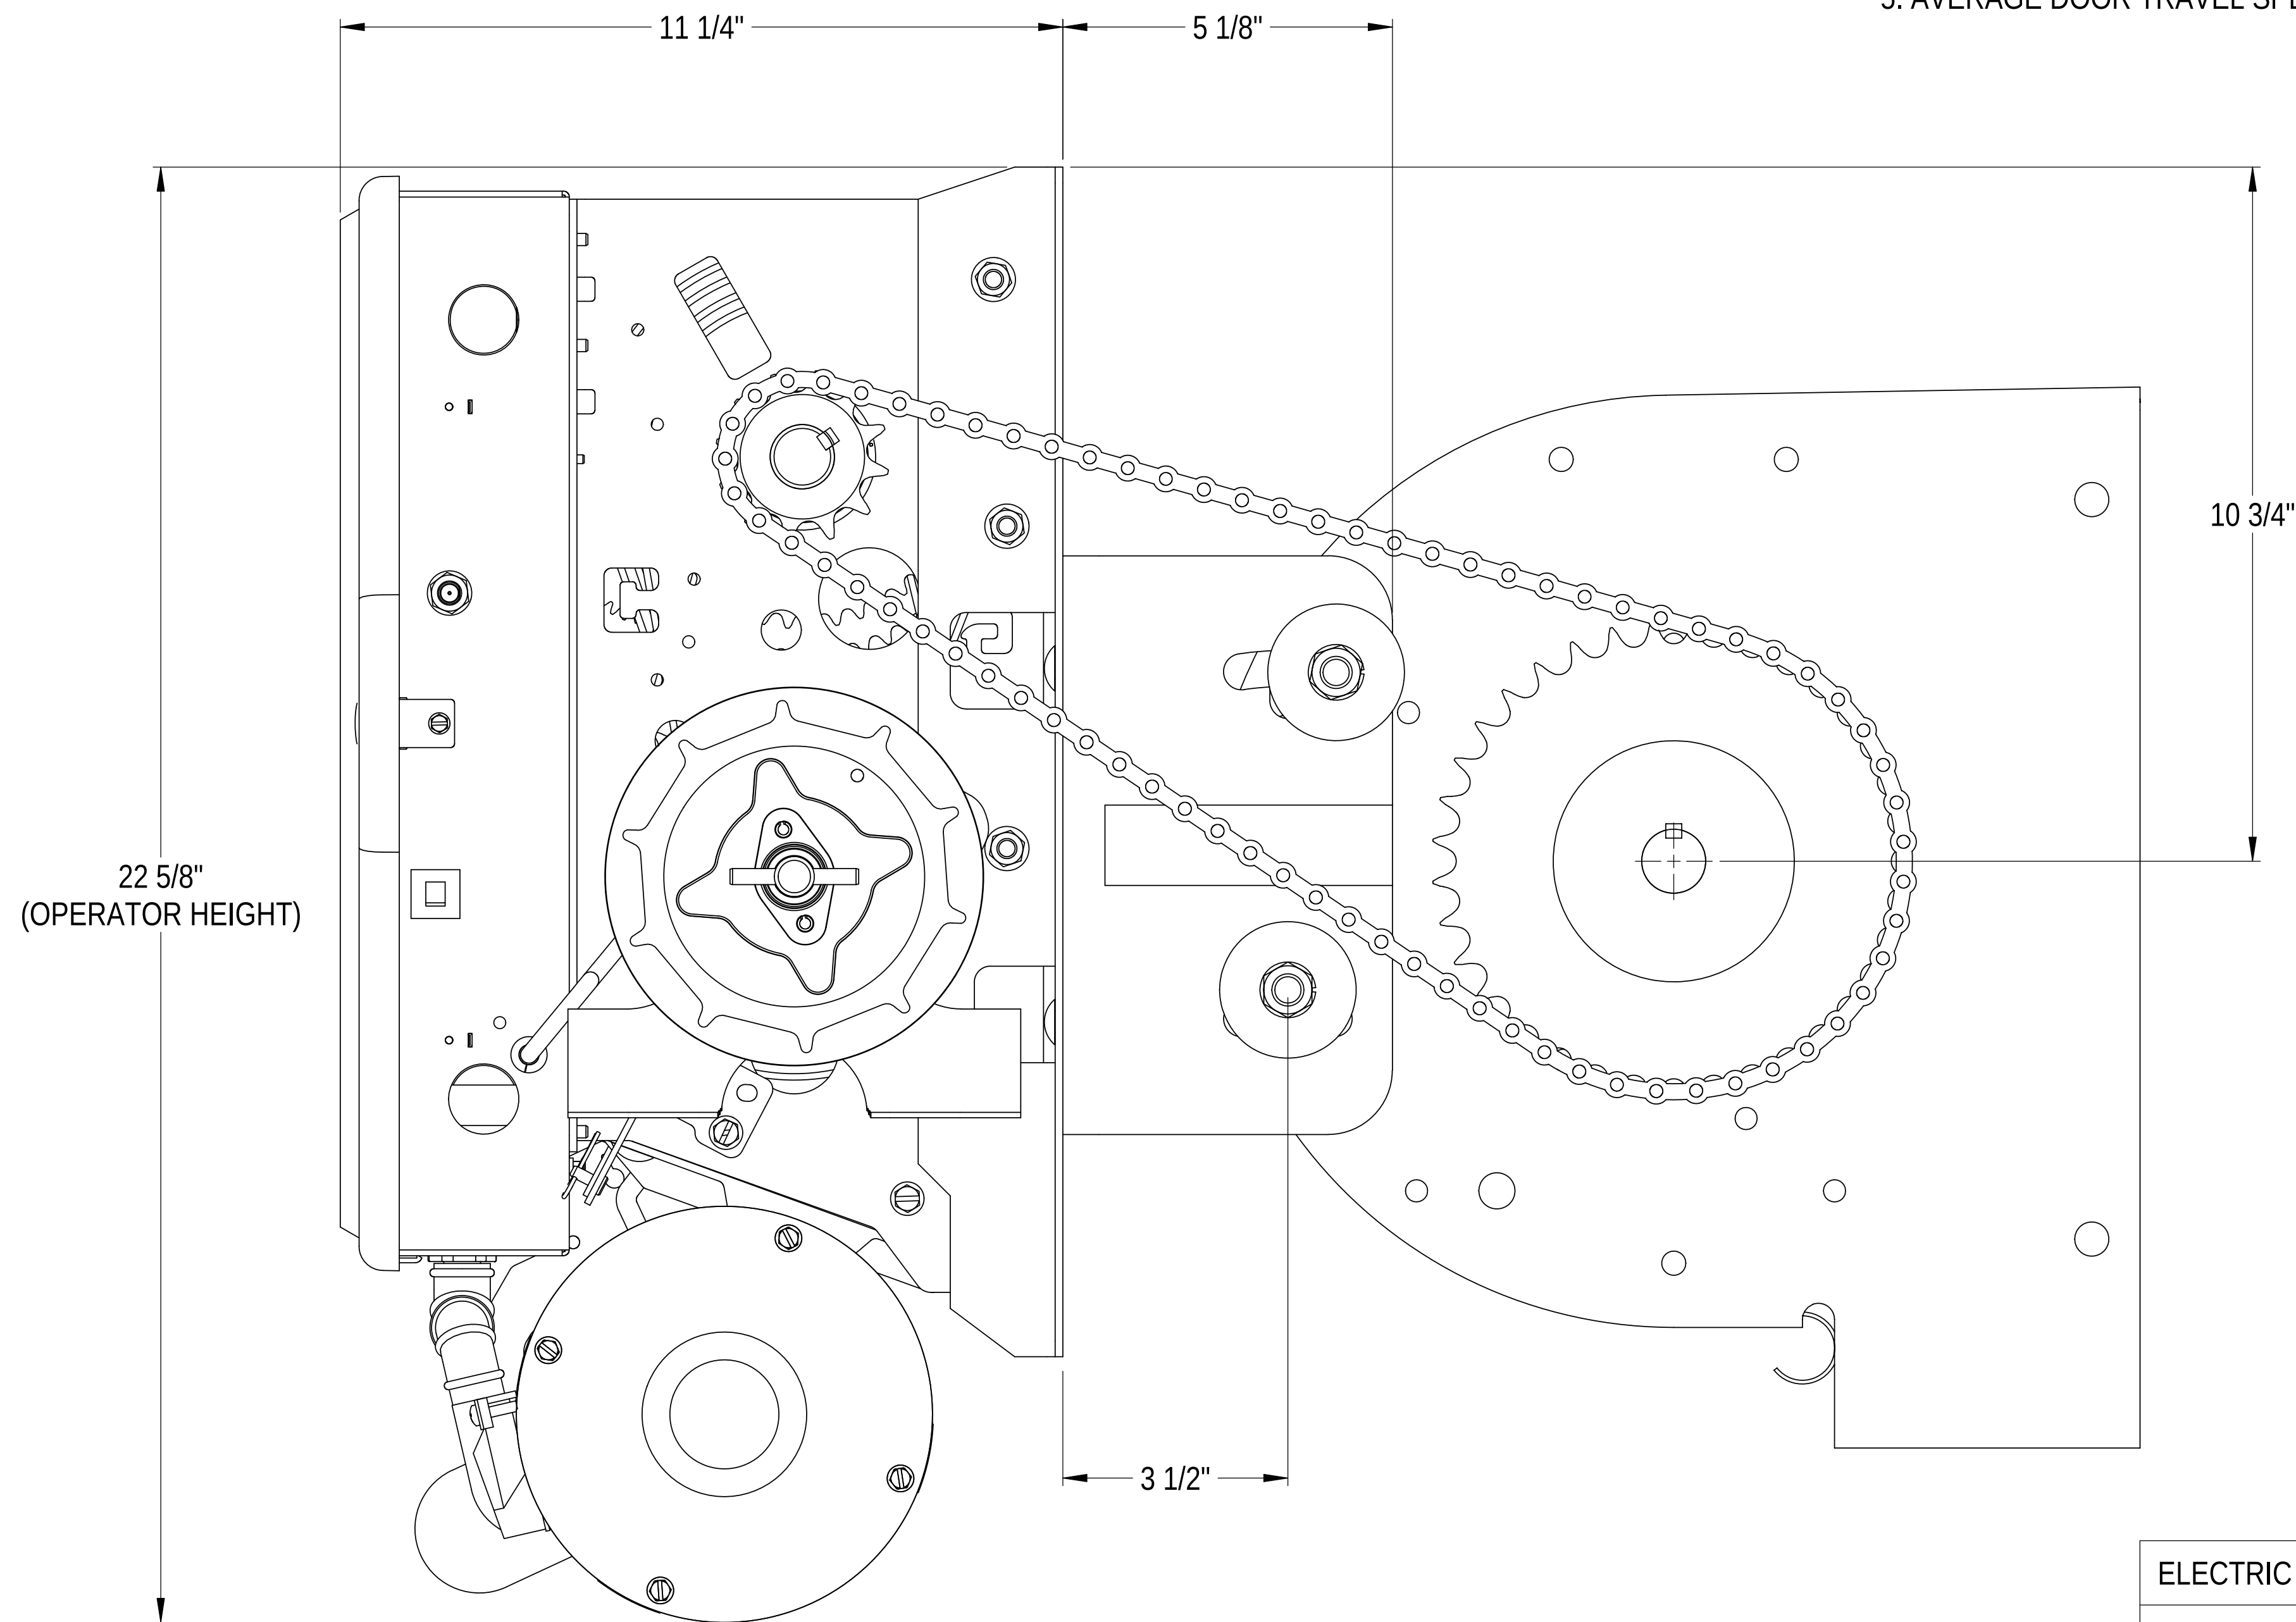

- NOTES:
1. PLEASE VERIFY VOLTAGE, PHASE & MOUNTING.
 2. ALL OPTIONAL ARE AT ADDED COST.
 3. A CLEARANCE OF 6" SHOULD BE ALLOWED FOR ACCESS TO ELECTRIC BOX.
 4. CONTROL VOLTAGE IS A NEC CLASS 2 CIRCUIT.
 5. AVERAGE DOOR TRAVEL SPEED IS 8" PER SECOND.

ARCHITECT DOOR NUMBER	QTY	FACTORY ORDER NUMBER	MOUNT TYPE	VOLTS					PHASE		CONTROL STATION		
			FRONT OF HOOD	115	208	230	460	575	1 PHASE	3 PHASE	3 BTN	KEY SWITCH	EXT. FLUSH 3 BUTTON

ELECTRIC OPERATOR: GCL-H (STANDARD DUTY)	
DOOR TYPE:	ROLLING STEEL
MOUNTING TYPE:	FRONT OF HOOD
PROJECT:	
ARCHITECT:	
CONTRACTOR:	
DISTRIBUTOR:	
PLANT:	
DRAWN BY:	DATE:
APPROVED BY:	DATE:
DWG NO.	SHT ____ OF ____
ENG. CERT. NO.	
112274.0001 REV. A	

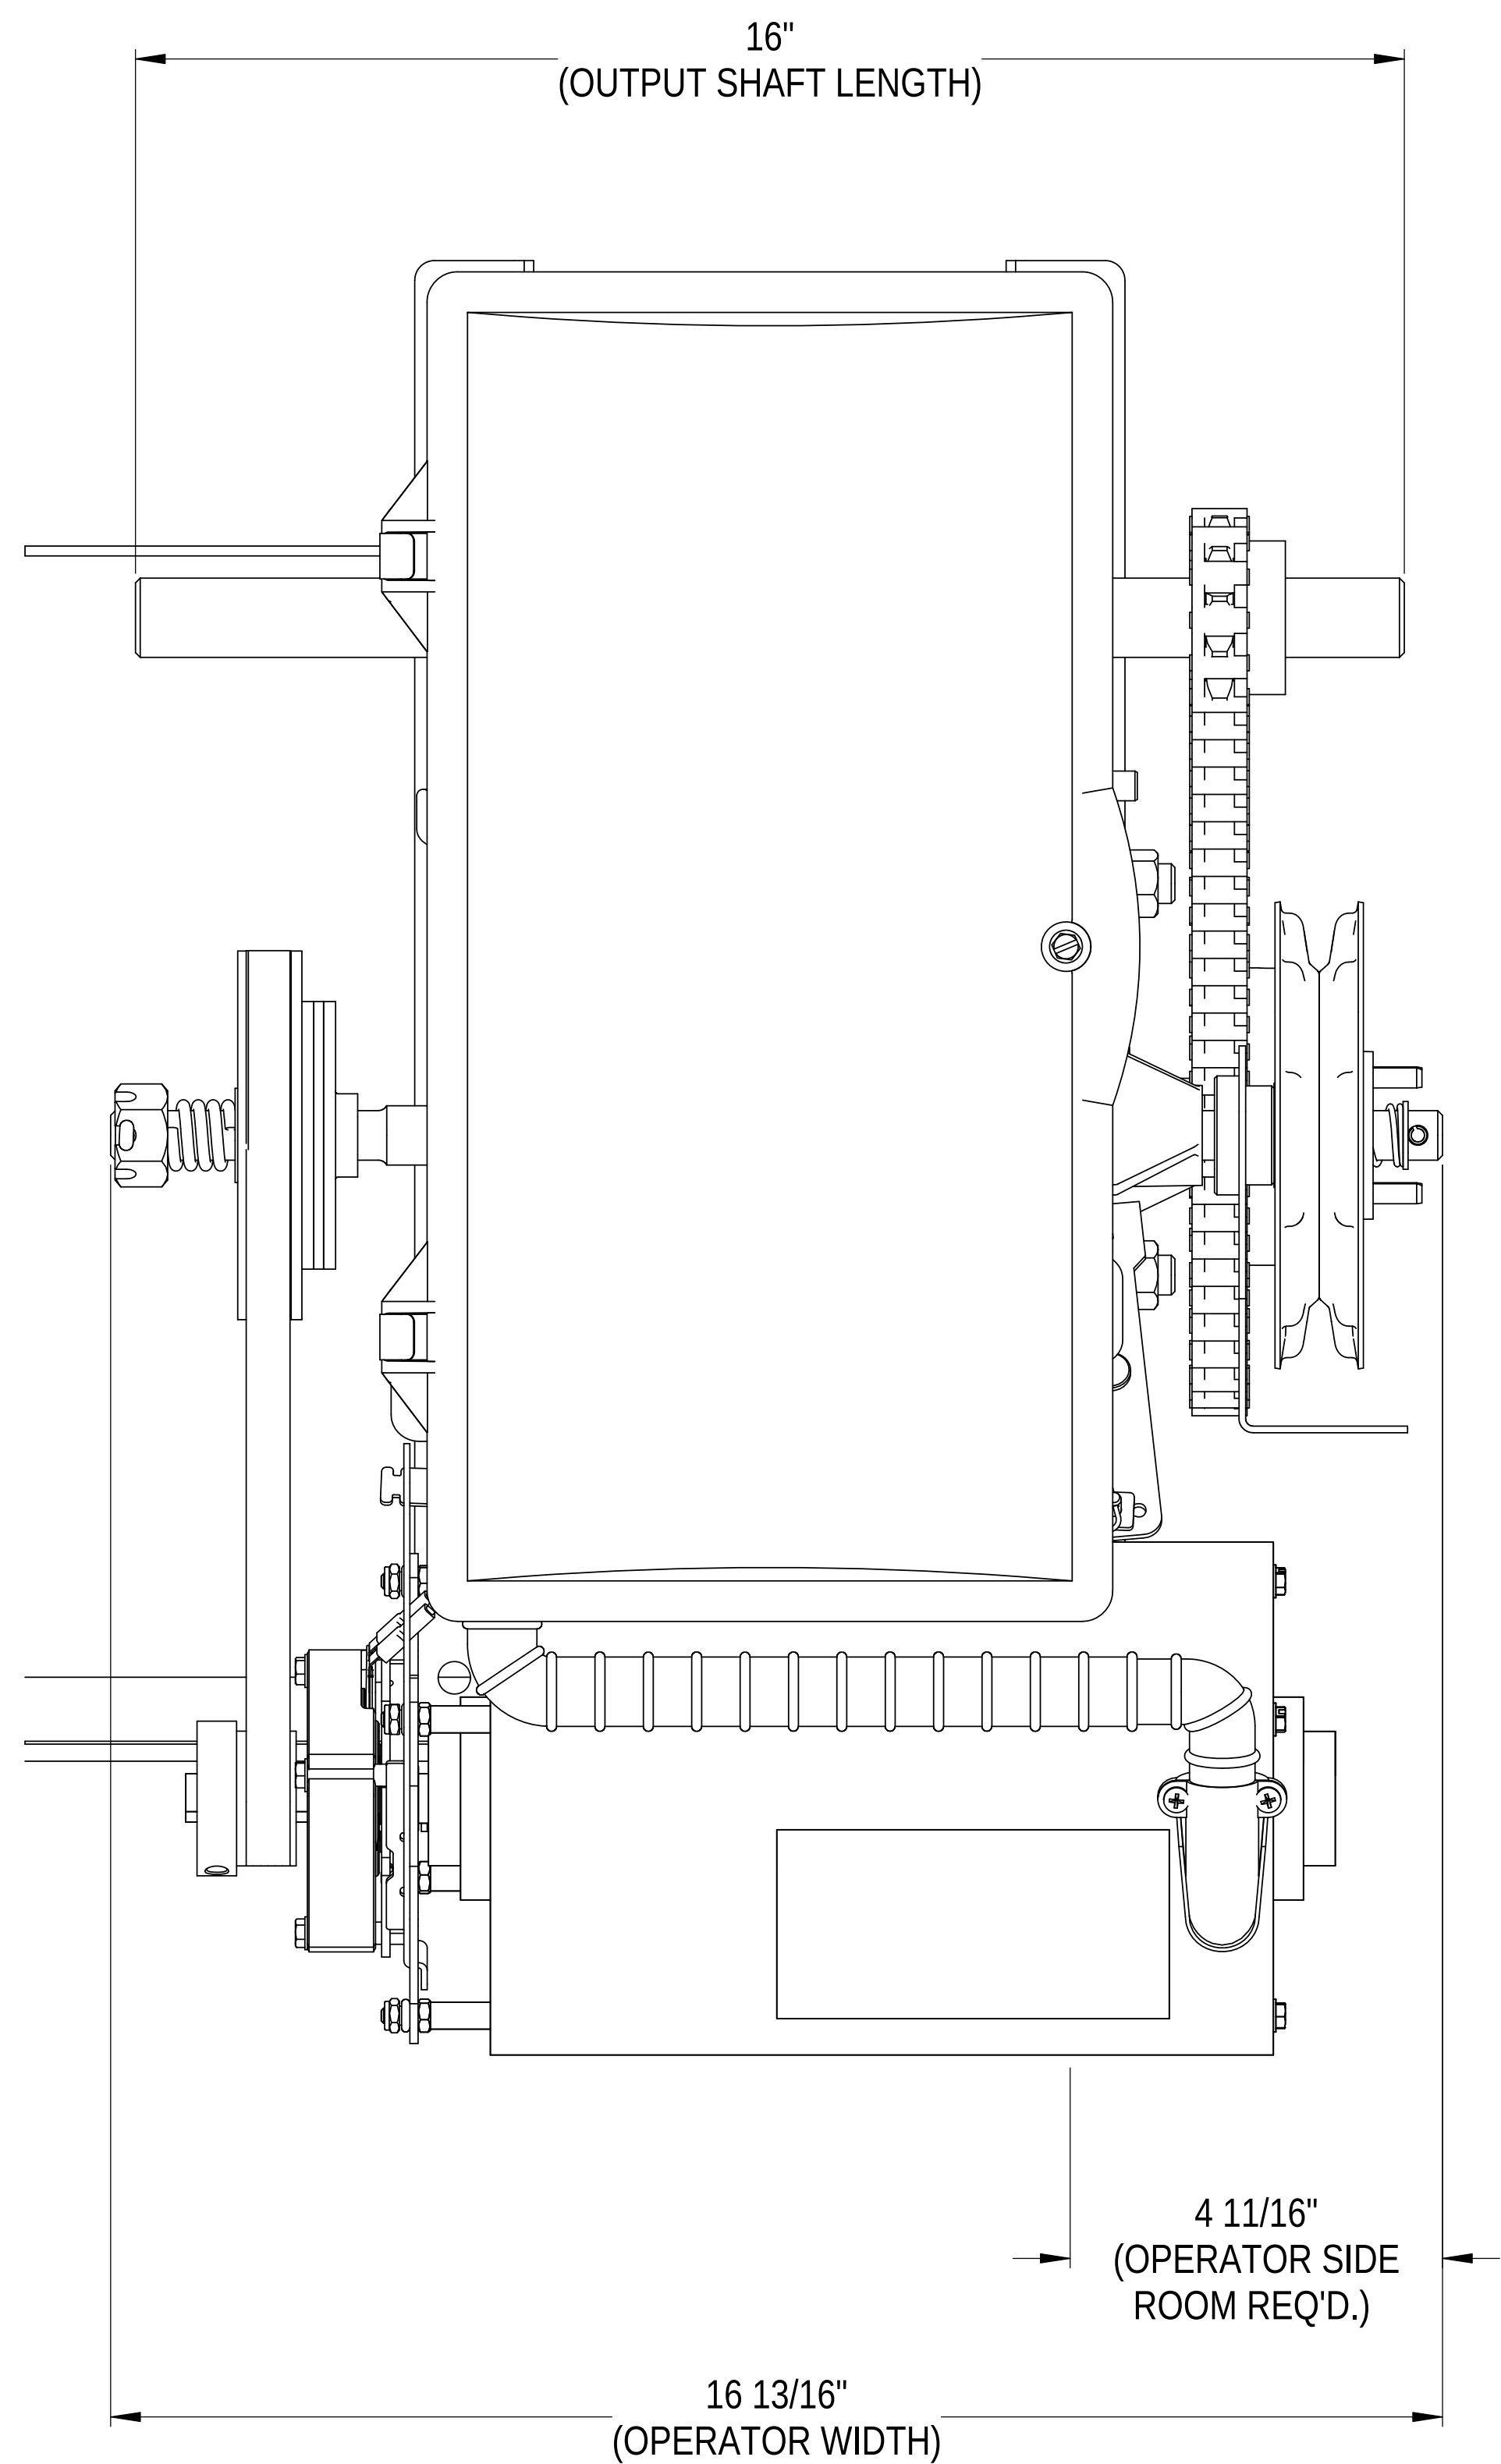