




- NOTES:
- 1. PLEASE VERIFY VOLTAGE, PHASE & MOUNTING.
 - 2. ALL OPTIONAL ARE AT ADDED COST.
 - 3. A CLEARANCE OF 6" SHOULD BE ALLOWED FOR ACCESS TO ELECTRIC BOX.
 - 4. CONTROL VOLTAGE IS A NEC CLASS 2 CIRCUIT.
 - 5. AVERAGE DOOR TRAVEL SPEED IS 8" PER SECOND.

ELECTRIC OPERATOR: GCL-GCX (COUNTER FIRE DOOR)	
DOOR TYPE:	COUNTER FIRE DOOR
MOUNTING TYPE:	FRONT OF HOOD
PROJECT:	
ARCHITECT:	
CONTRACTOR:	
DISTRIBUTOR:	
PLANT:	
DRAWN BY:	DATE:
APPROVED BY:	DATE:
DWG NO.	SHT ____ OF ____
ENG. CERT. NO.	
113518.0001 REV. -	

ARCHITECT DOOR NUMBER	QTY	FACTORY ORDER NUMBER	MOUNT TYPE	VOLTS	PHASE	CONTROL STATION		
			FRONT OF HOOD	115	1 PHASE	3 BTN	KEY SWITCH	EXT. FLUSH 3 BUTTON

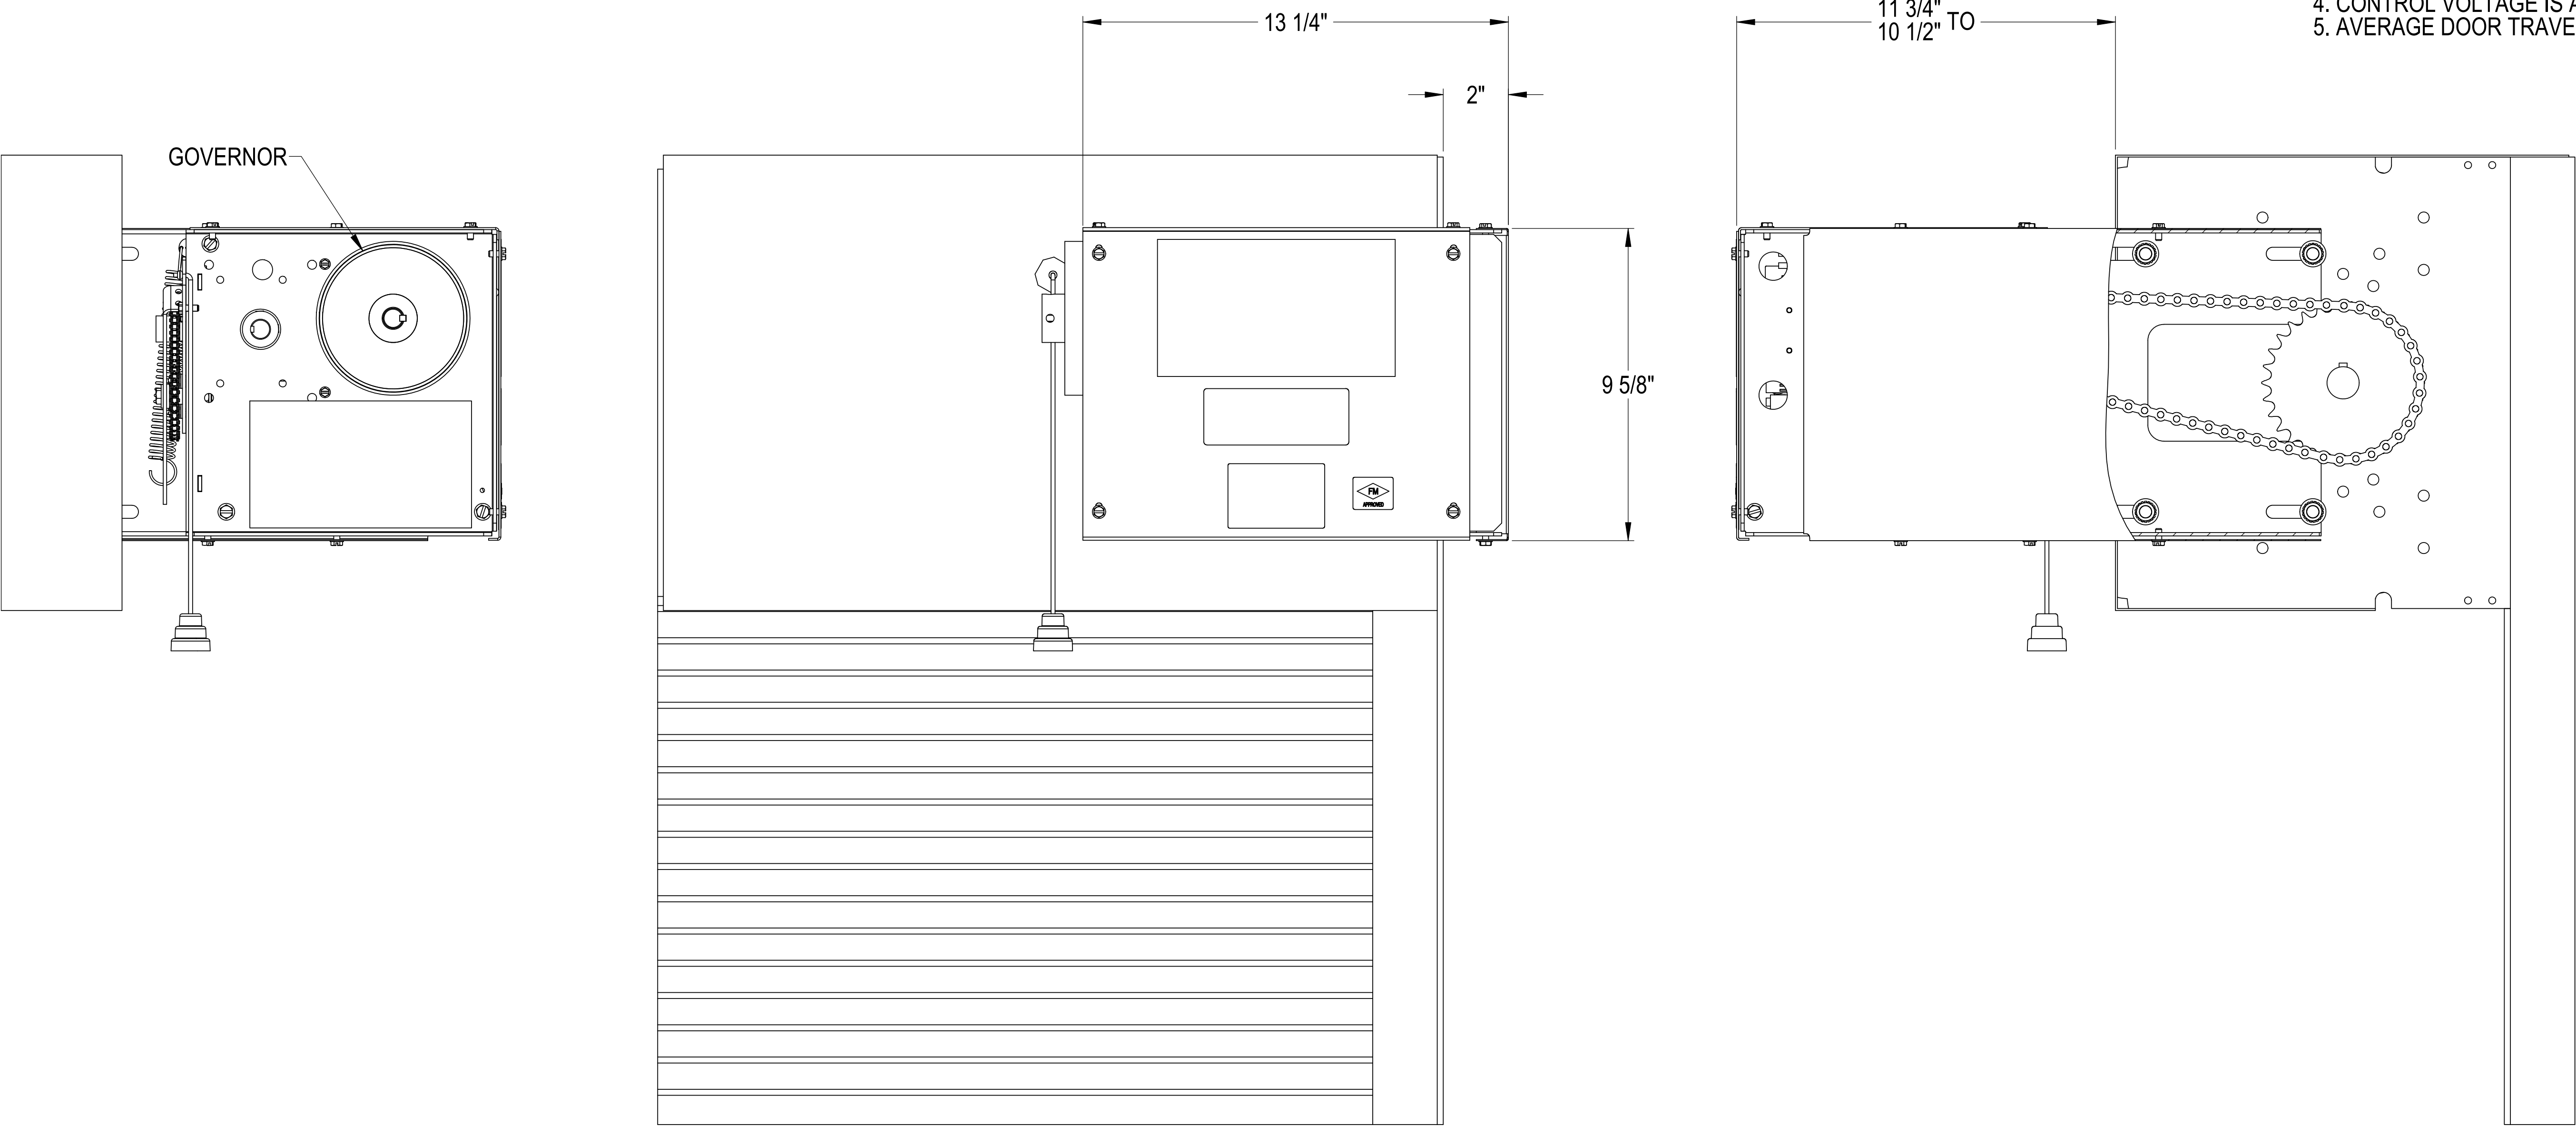