



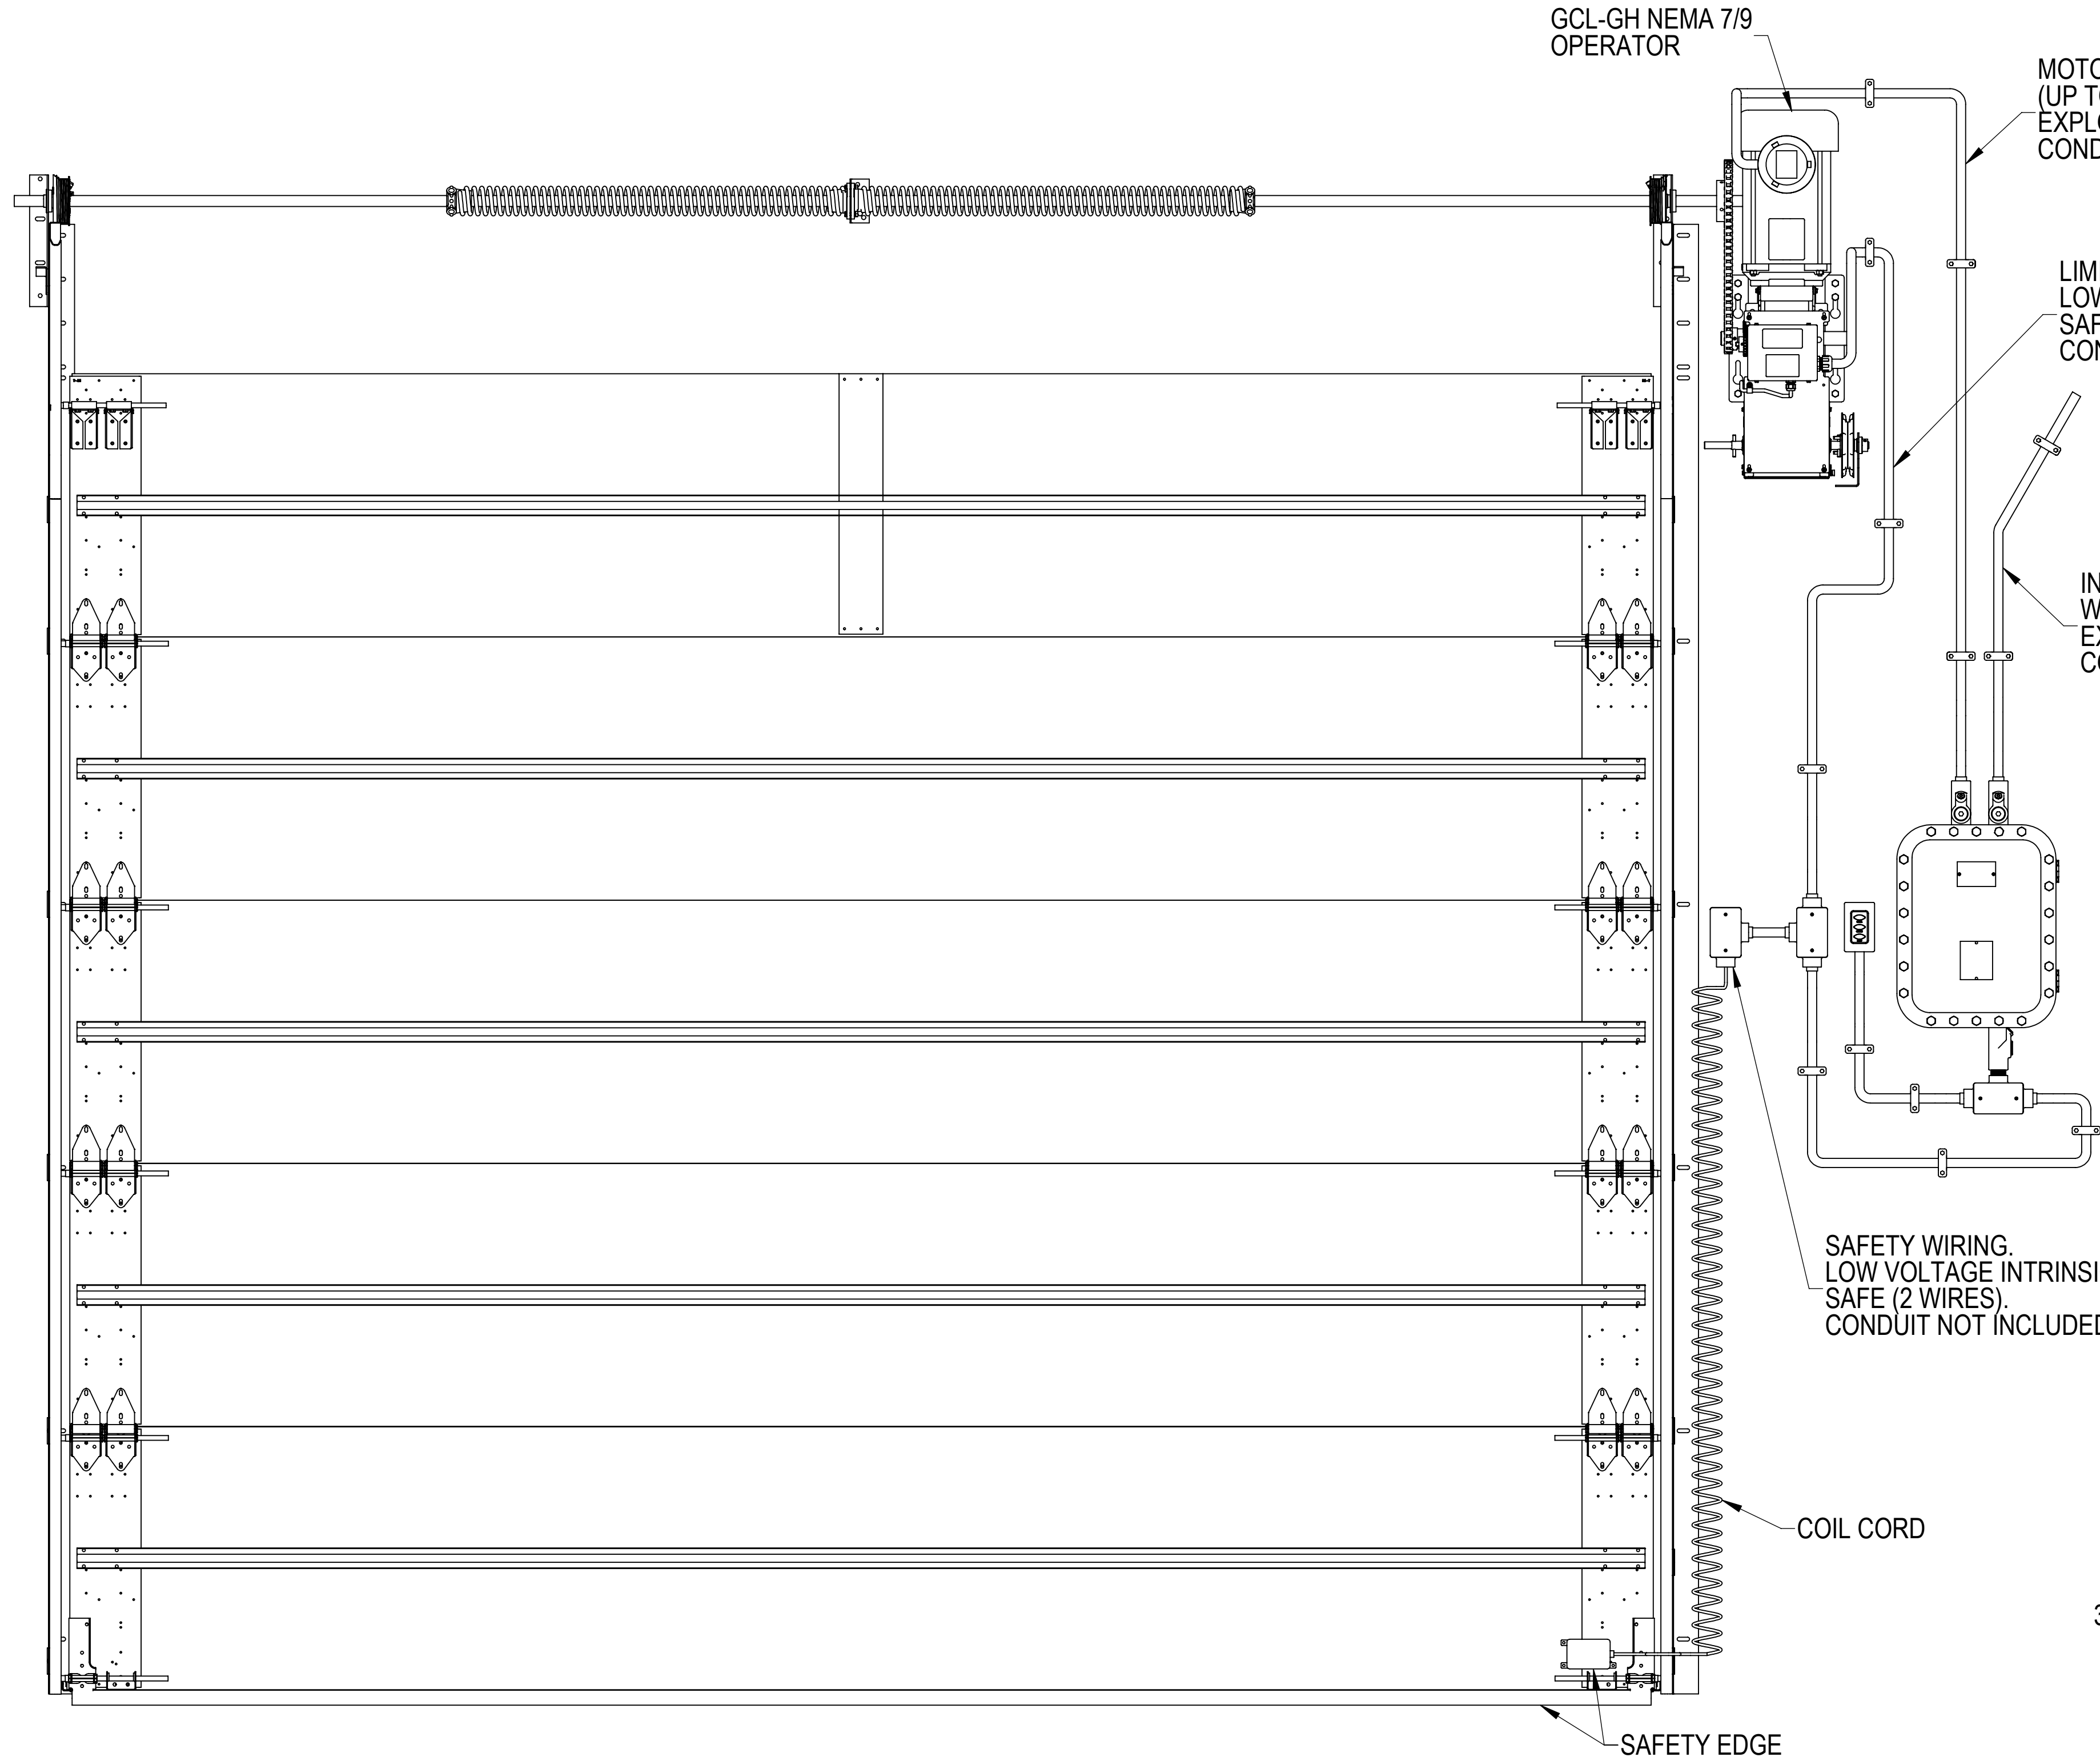


TYPICAL INSTALLATION

- NOTES:
- 1. PLEASE VERIFY VOLTAGE, PHASE & MOUNTING.
 - 2. ALL OPTIONS ARE AT ADDED COST.
 - 3. OPERATOR MOUNTS TO DOOR THE SAME AS A STANDARD 3HP GCL-GH. (REFER TO STANDARD 3HP GCL-GH SHOP DRAWING FOR OPERATOR MOUNTING POSITION AND LOCATION).
 - 4. WIRE SIZE TO BE DETERMINED BY A LICENSED ELECTRICIAN.
 - 5. IT IS RECOMMENDED THAT THE OPERATOR BE BRACED TO THE WALL FOR STABILIZING AND A SAFETY CABLE ATTACHED.

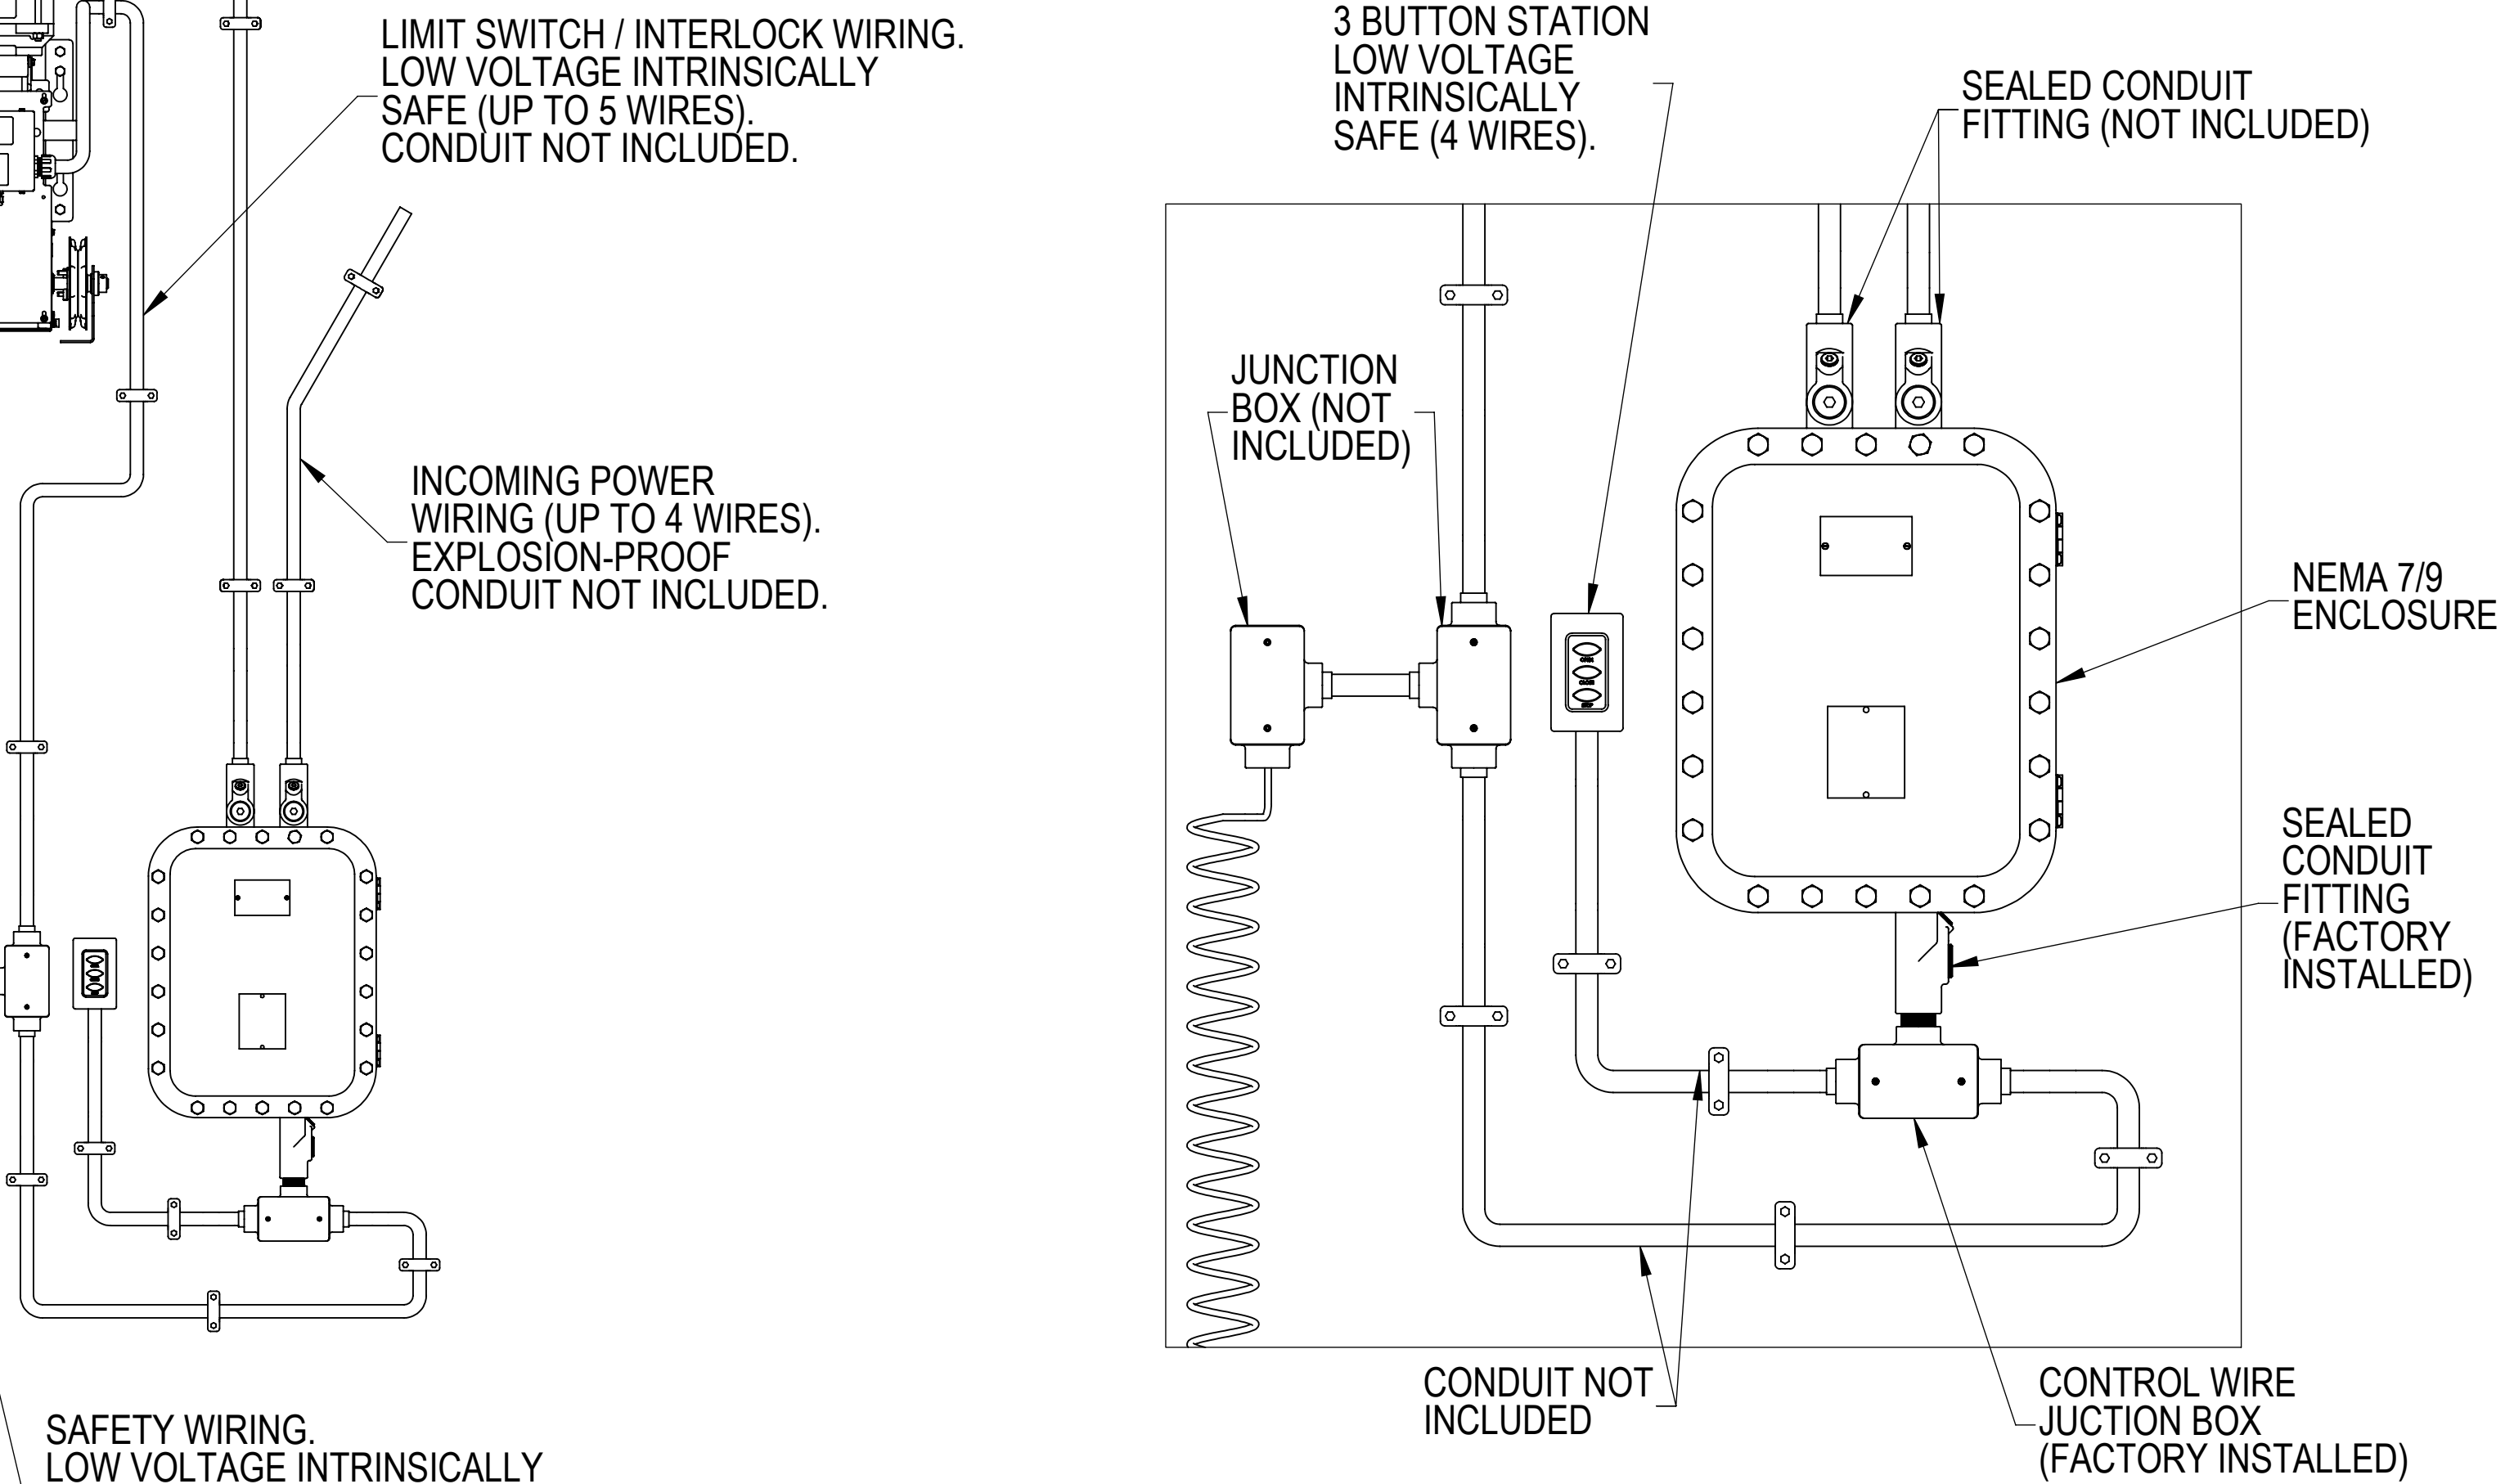

TYPICAL MOUNTING ARRANGEMENT

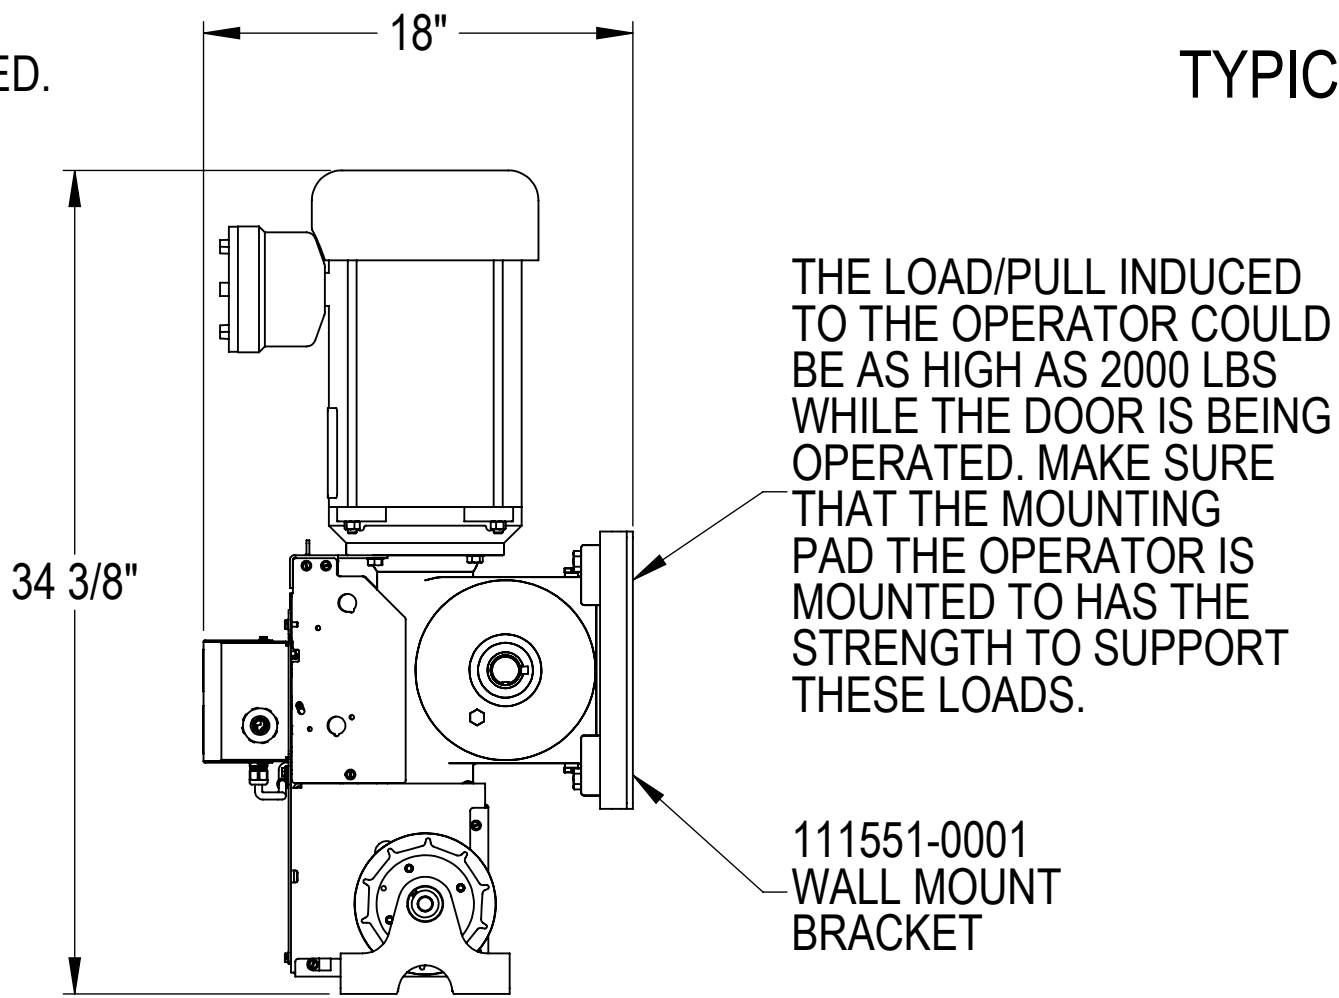

ARCHITECT DOOR NUMBER	QTY	FACTORY ORDER NUMBER	MOUNT TYPE	VOLTS				PHASE		CONTROL STATION		
			WALL MOUNT	115	208	230	460	1 PHASE	3 PHASE	3 BTN	KEY SWITCH	EXT. FLUSH 3 BUTTON

ELECTRIC OPERATOR: GCL-GH (NEMA 7/9) (3HP)	
DOOR TYPE:	SECTIONAL
MOUNTING TYPE:	WALL MOUNT
PROJECT:	
ARCHITECT:	
CONTRACTOR:	
DISTRIBUTOR:	
PLANT:	
DRAWN BY:	DATE:
APPROVED BY:	DATE:
DWG NO.	SHT ____ OF ____
ENG. CERT. NO.	
112711-0001	

