


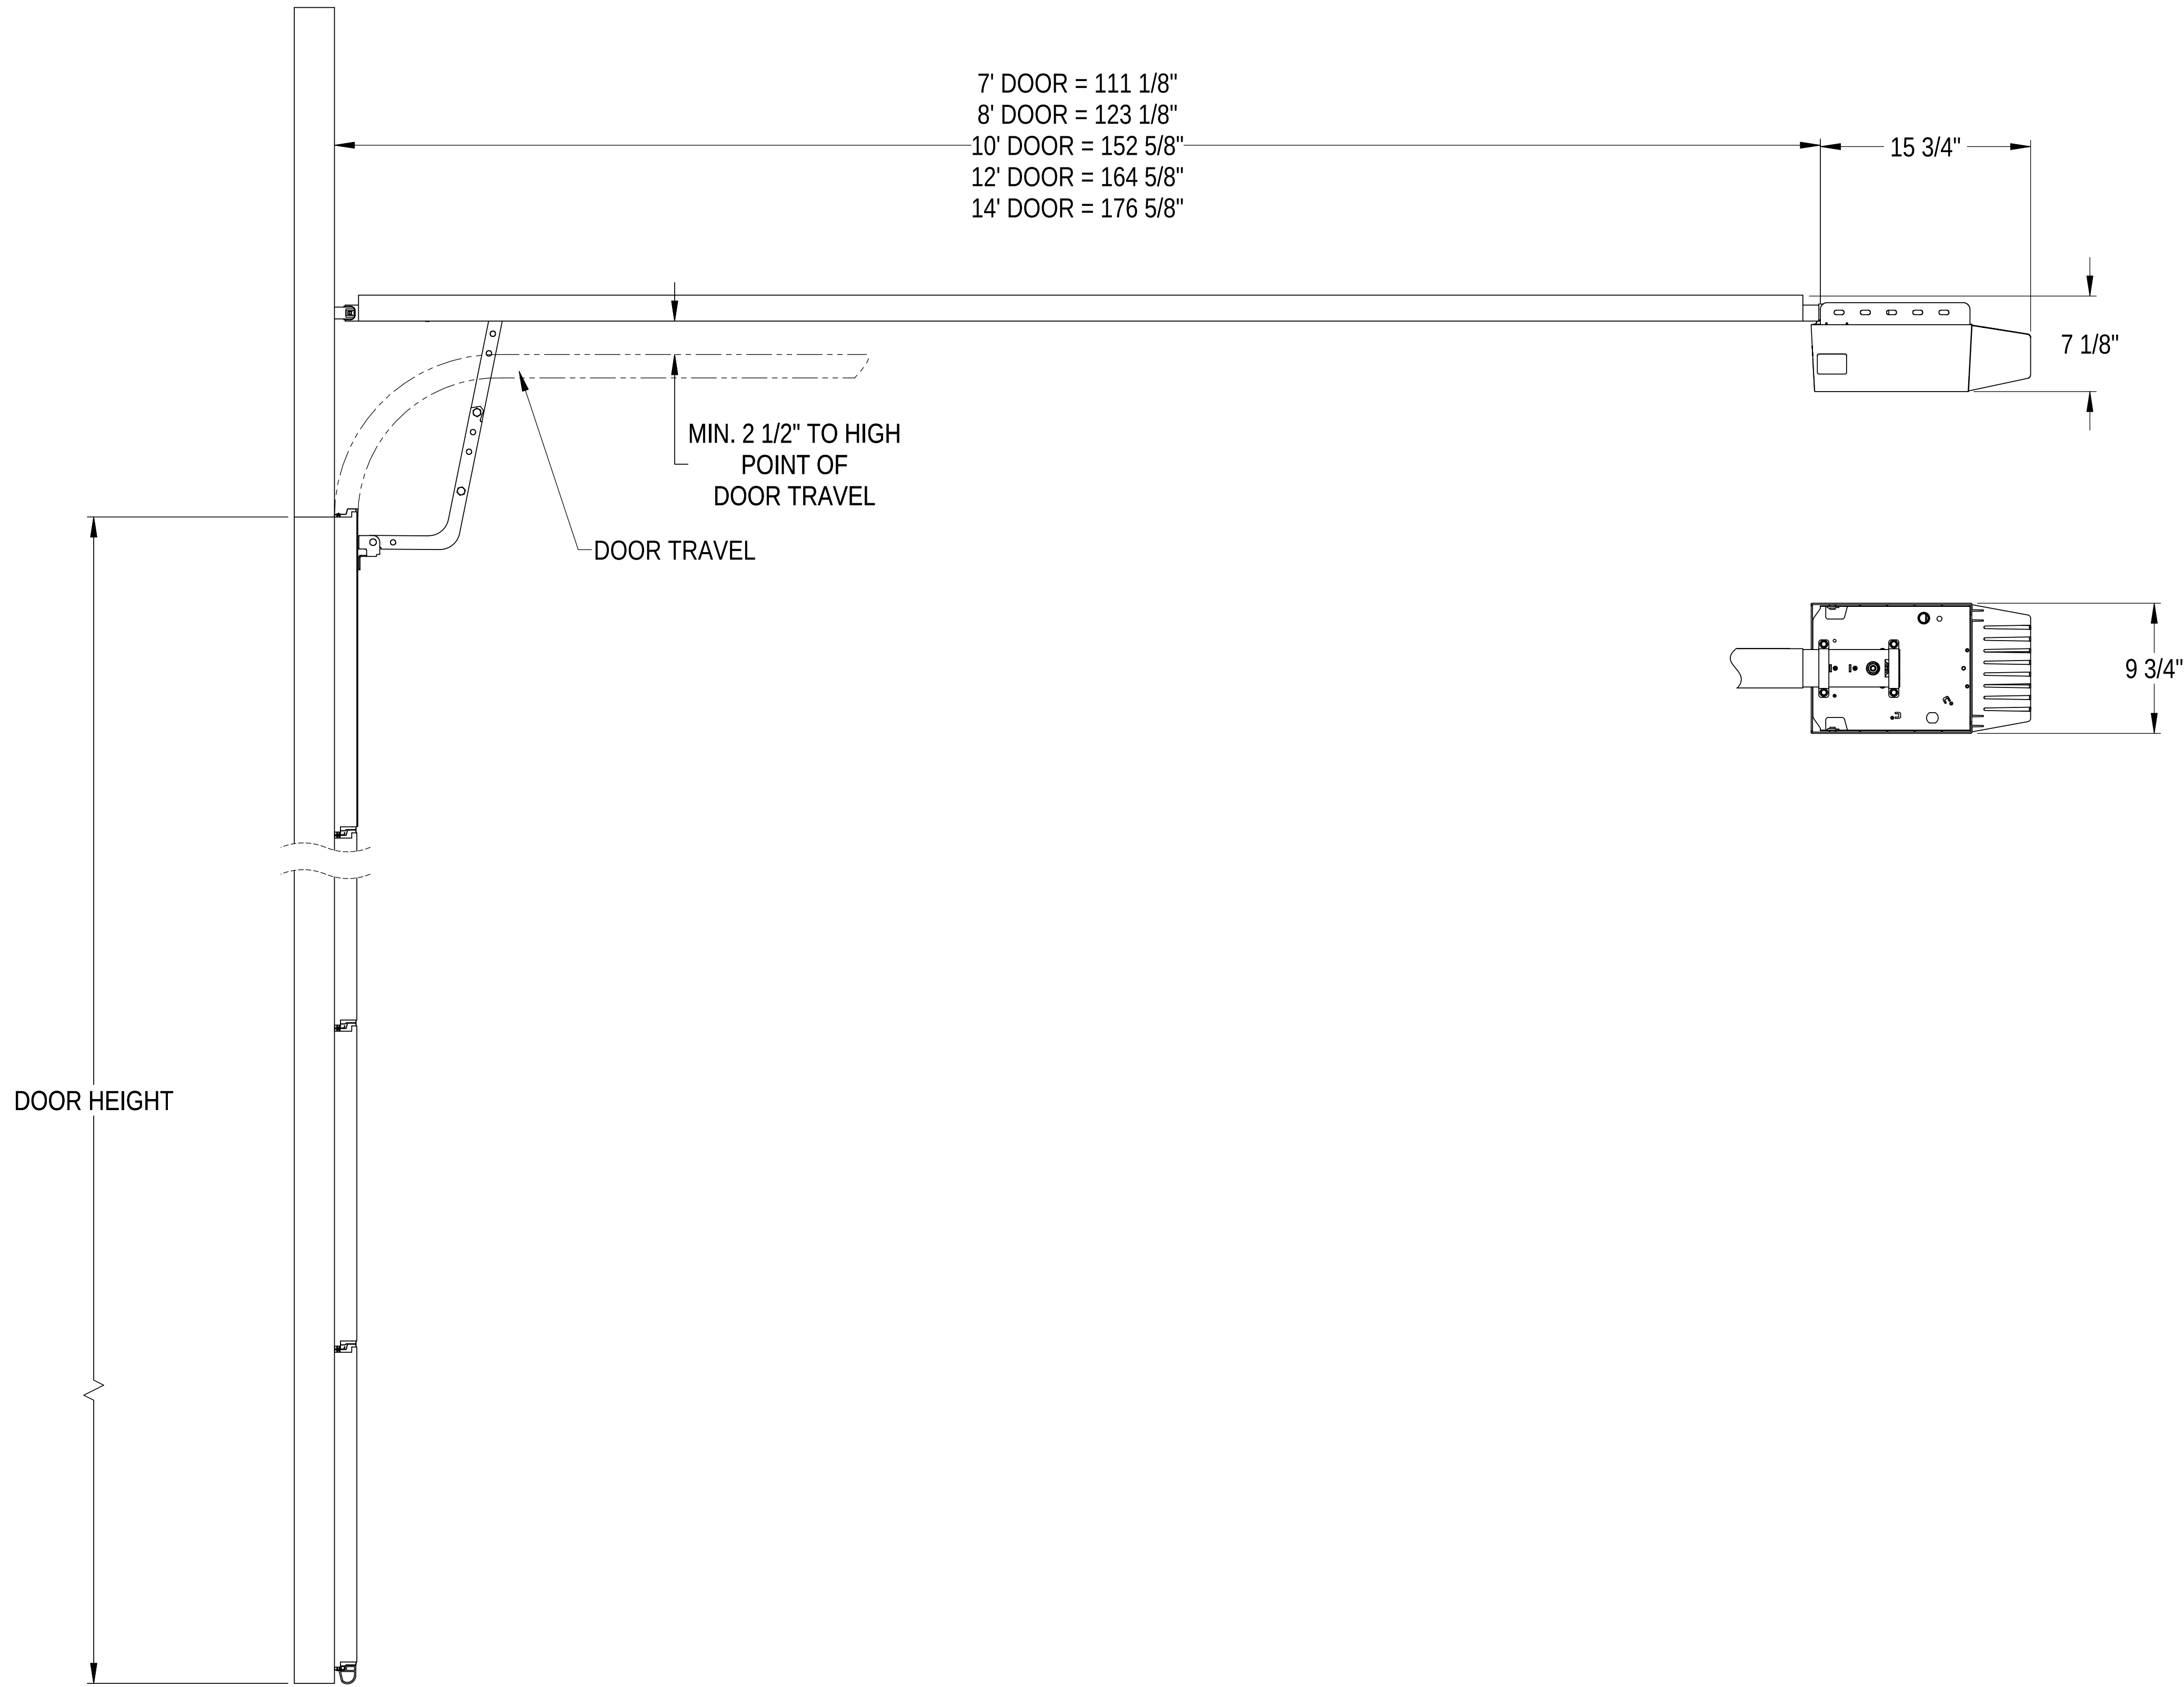

- NOTES:
- 1. PLEASE VERIFY VOLTAGE, PHASE & MOUNTING.
 - 2. ALL OPTIONS ARE AT ADDED COST.
 - 3. A CLEARANCE OF 6" SHOULD BE ALLOWED FOR ACCESS TO ELECTRIC BOX.
 - 4. CONTROL VOLTAGE IS A NEC CLASS 2 CIRCUIT.
 - 5. AVERAGE DOOR TRAVEL SPEED IS 7.5" PER SECOND.

ARCHITECT DOOR NUMBER	QTY	FACTORY ORDER NUMBER	MOUNT TYPE	VOLTS	PHASE	CONTROL STATION		
			TROLLEY	115	1 PHASE	3 BTN	KEY SWITCH	EXT. FLUSH 3 BUTTON

ELECTRIC OPERATOR: GLD LIGHT DUTY TROLLEY	
DOOR TYPE: SECTIONAL	
MOUNTING TYPE: TROLLEY	
PROJECT:	
ARCHITECT:	
CONTRACTOR:	
DISTRIBUTOR:	
PLANT:	
DRAWN BY:	DATE:
APPROVED BY:	DATE:
DWG NO.	SHT __ OF __
ENG. CERT. NO.	
113260	