

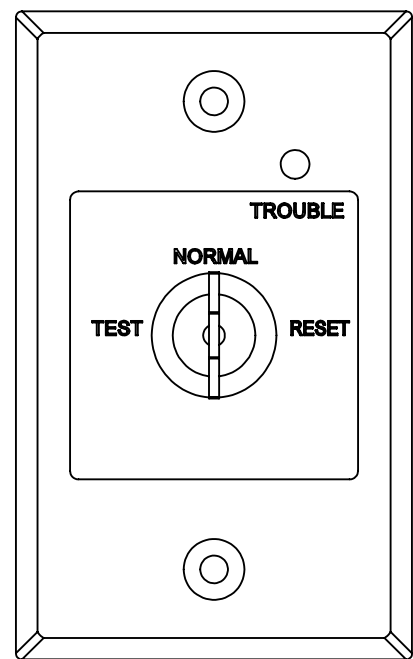
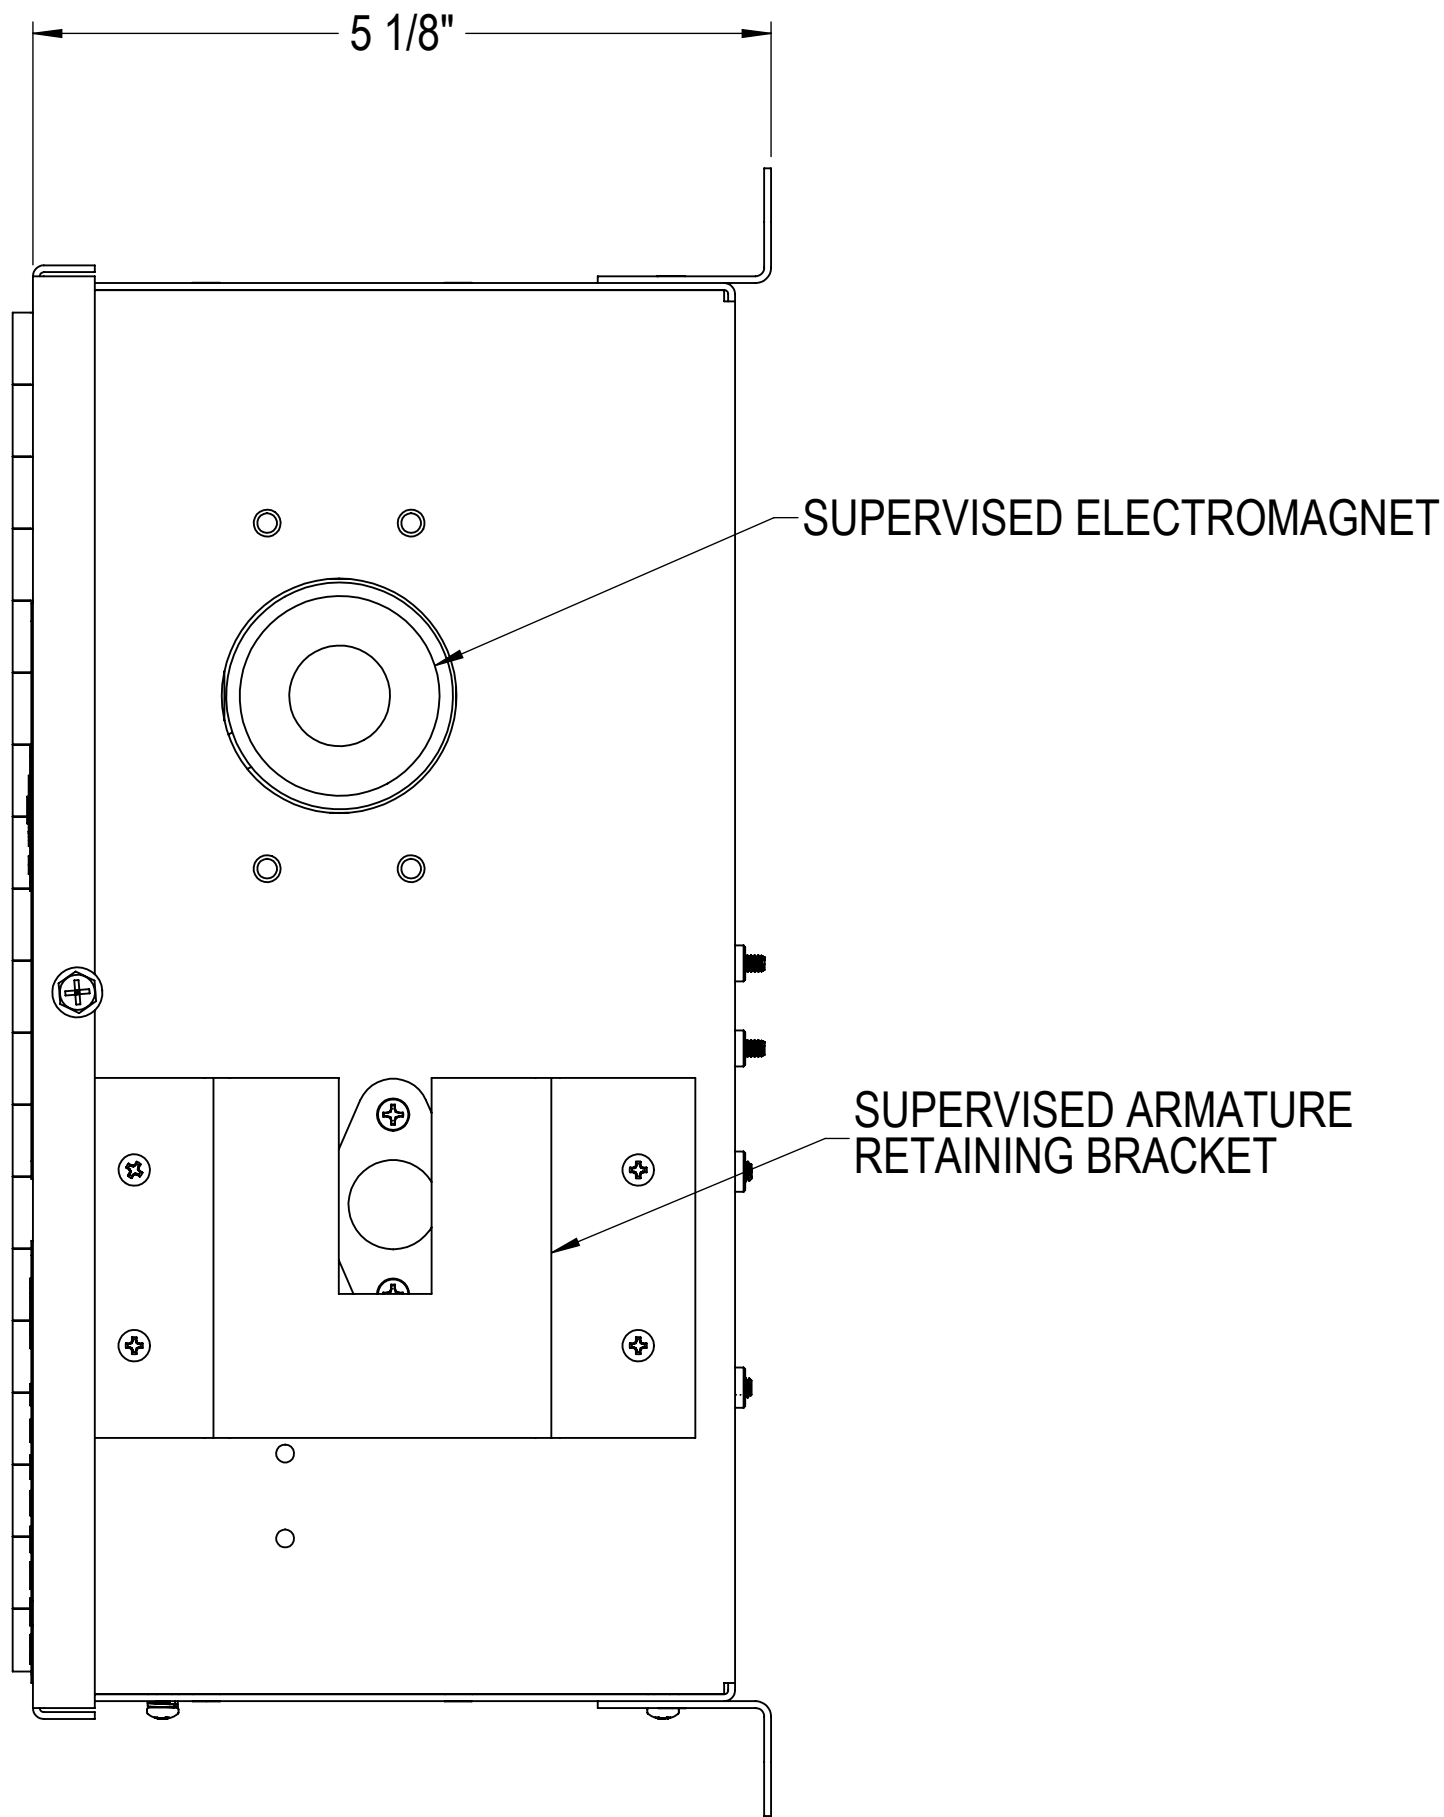


NOTES:
1. 40LB MAX SUPPORT AND RELEASE LOAD RATING

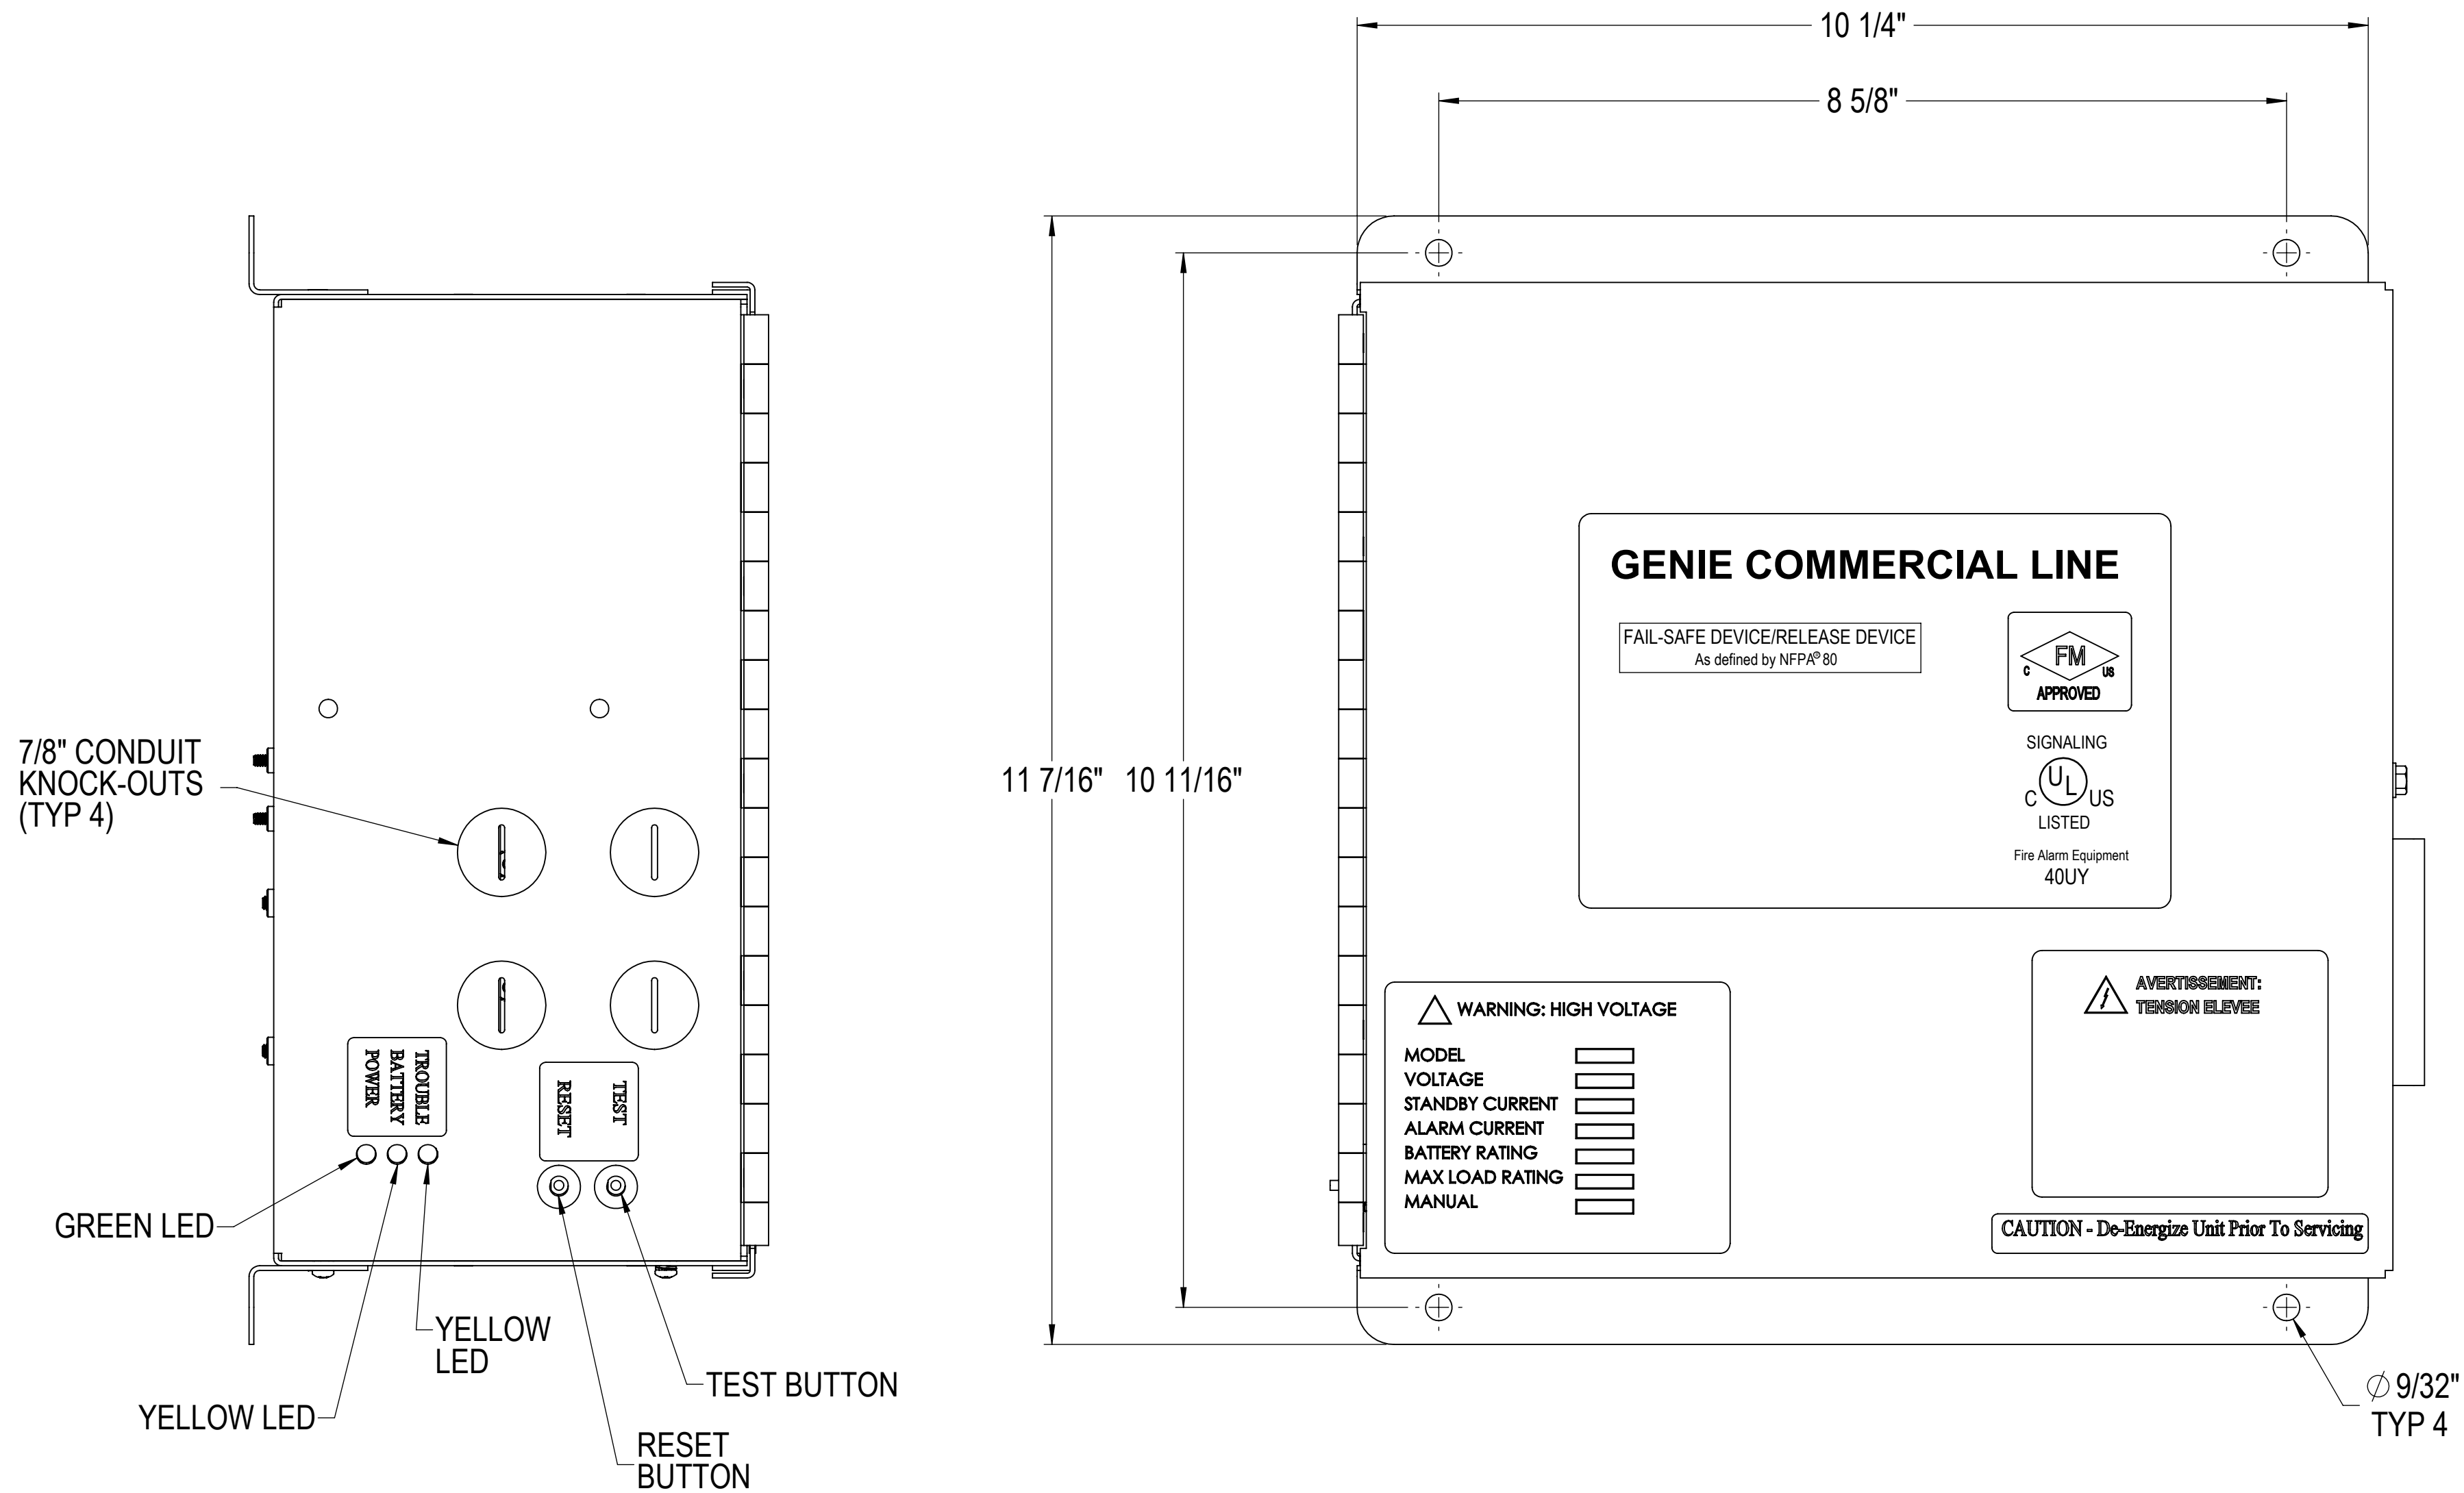

KEY SWITCH

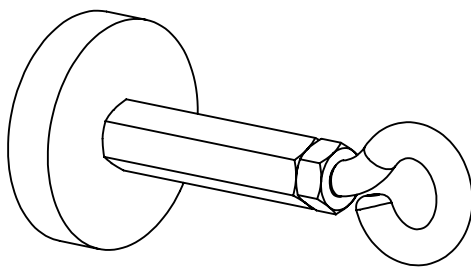

ARMATURE

MODEL NO.	VOLTAGE	TYPE
FDRDA24	24 VDC	NON-MOTORIZED DOOR
FDRDB24	24 VDC	
FDRDB120	120 VAC	
FDRDC24	24 VDC	MOTORIZED DOOR
FDRDC120	120 VAC	

FIRE DOOR FAIL-SAFE DEVICE / RELEASE DEVICE

DOOR TYPE:

PROJECT:

ARCHITECT:

CONTRACTOR:

DISTRIBUTOR:

PLANT:

DRAWN BY:

DATE:

APPROVED BY:

DATE:

DWG NO.

SHT ____ OF ____

ENG. CERT. NO.

112415.0001 REV. A

