

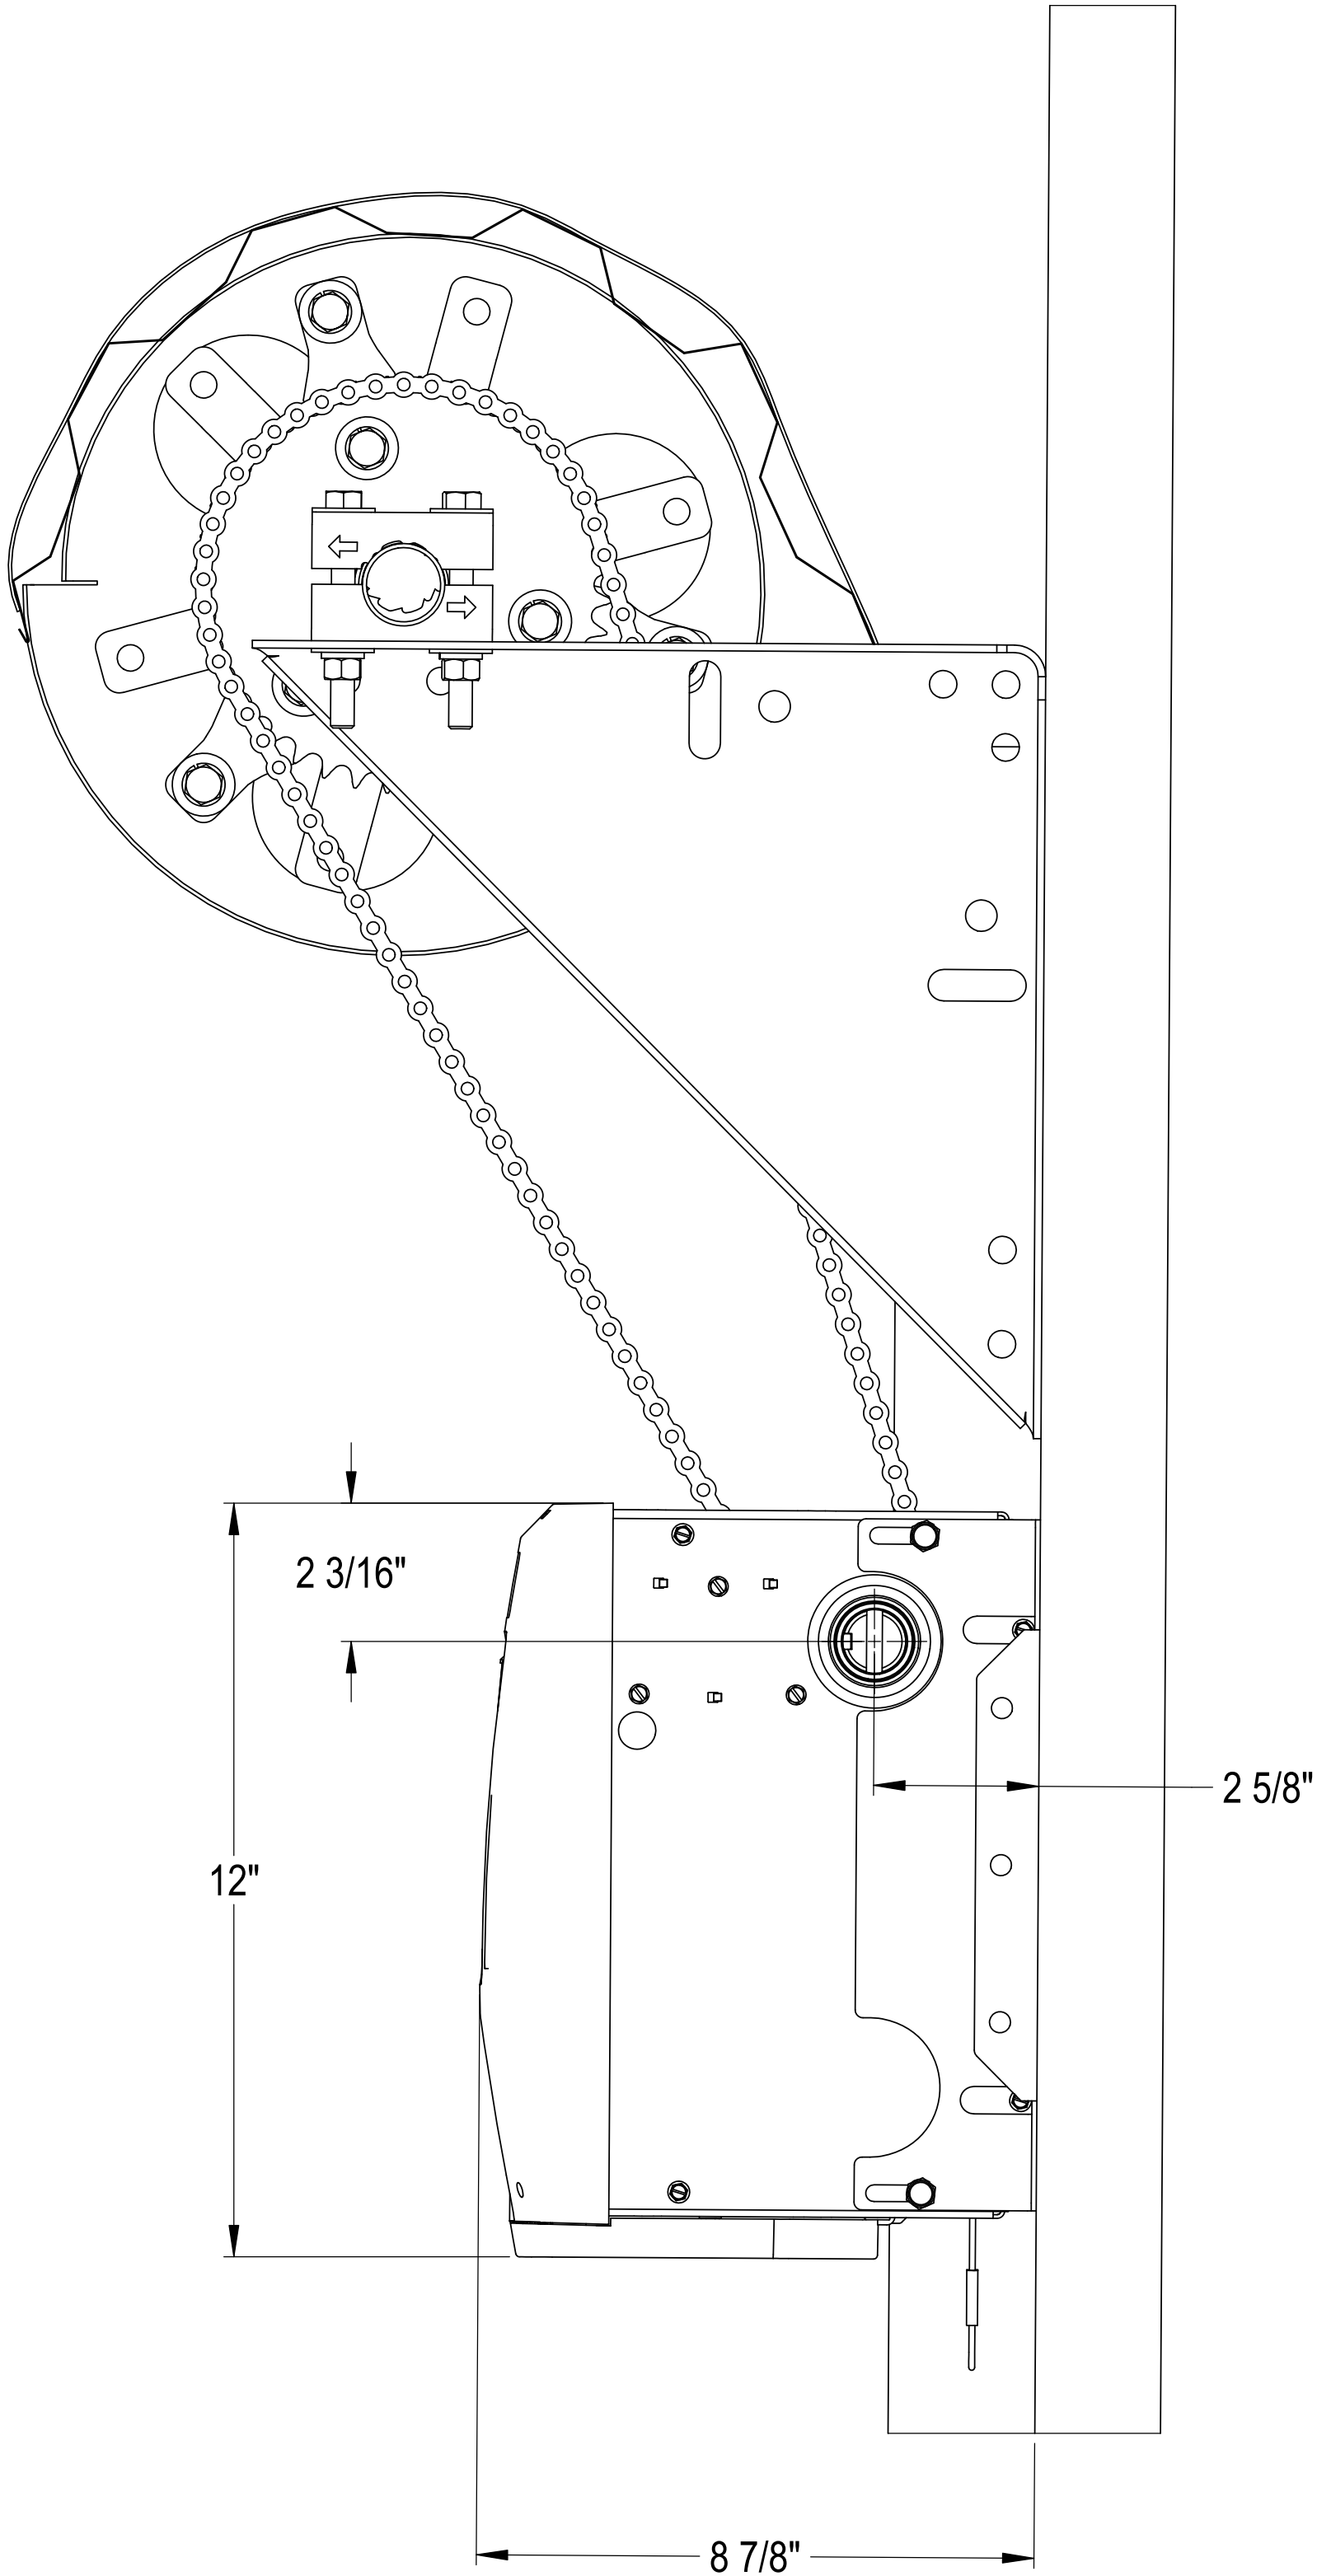


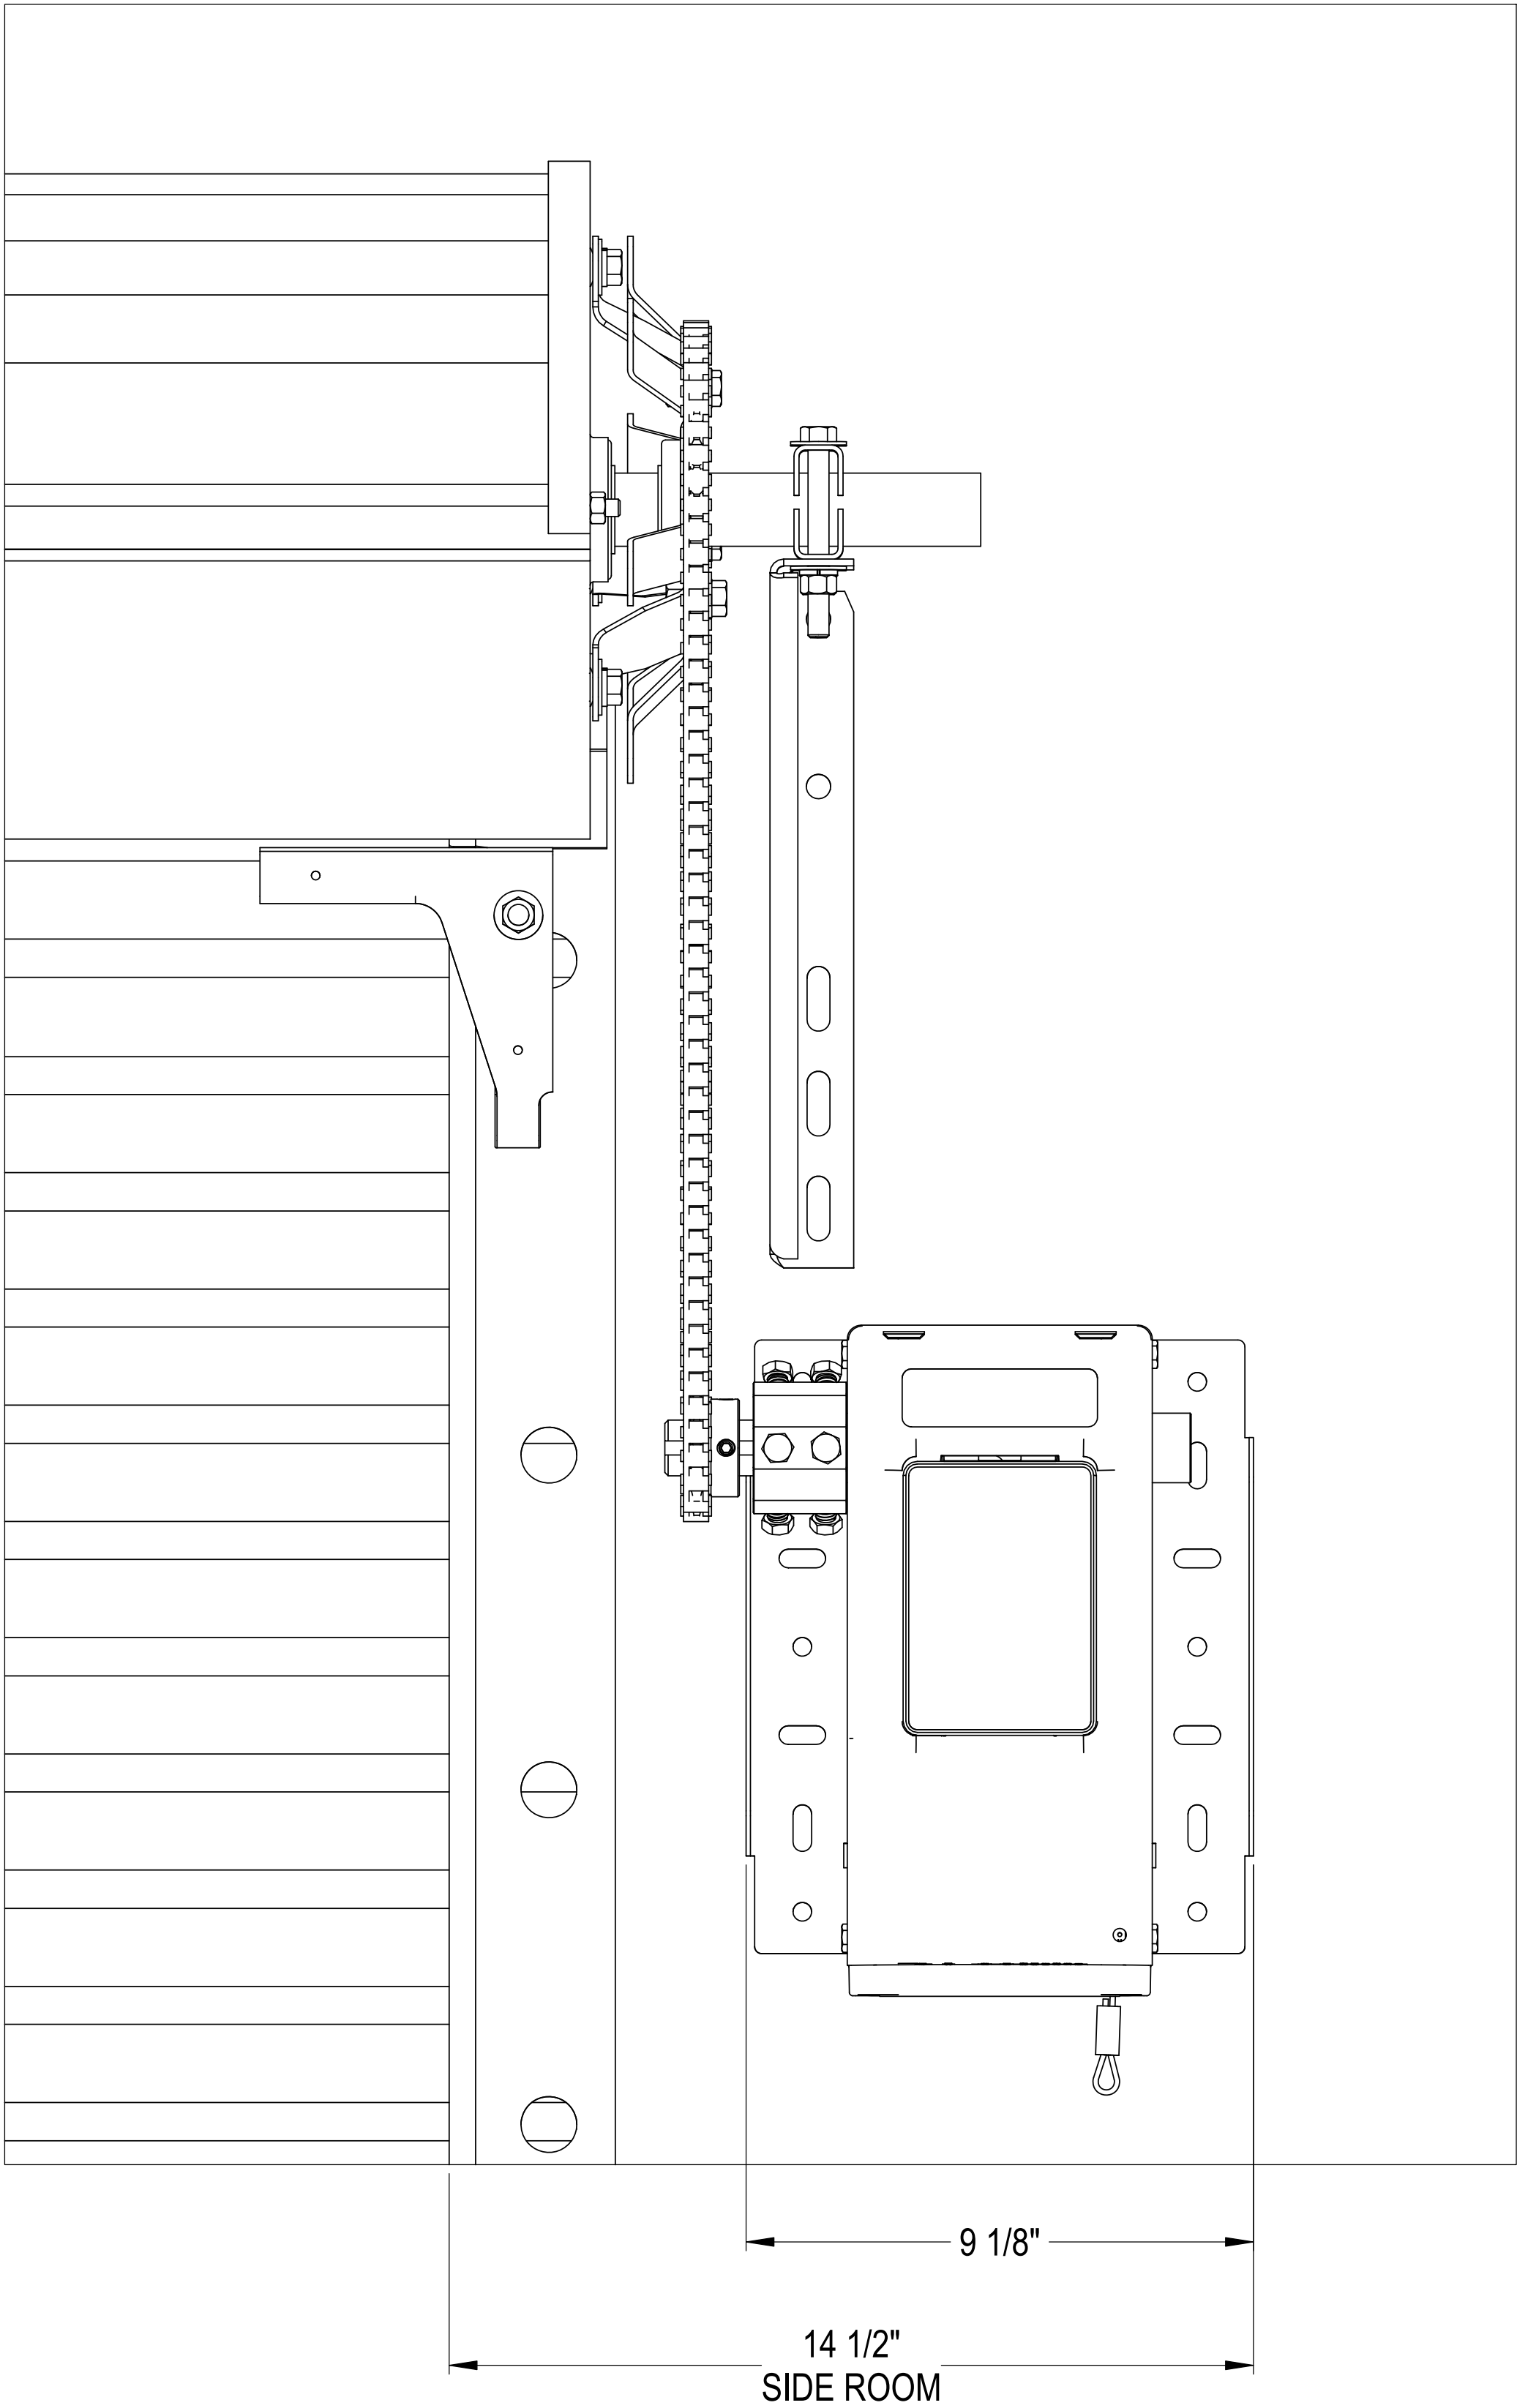

- NOTES:
- 1. PLEASE VERIFY VOLTAGE, PHASE & MOUNTING.
 - 2. ALL OPTIONS ARE AT ADDED COST.
 - 3. A CLEARANCE OF 6" SHOULD BE ALLOWED FOR ACCESS TO ELECTRIC BOX.
 - 4. CONTROL VOLTAGE IS A NEC CLASS 2 CIRCUIT.
 - 5. AVERAGE DOOR TRAVEL SPEED IS ___ PER SECOND.

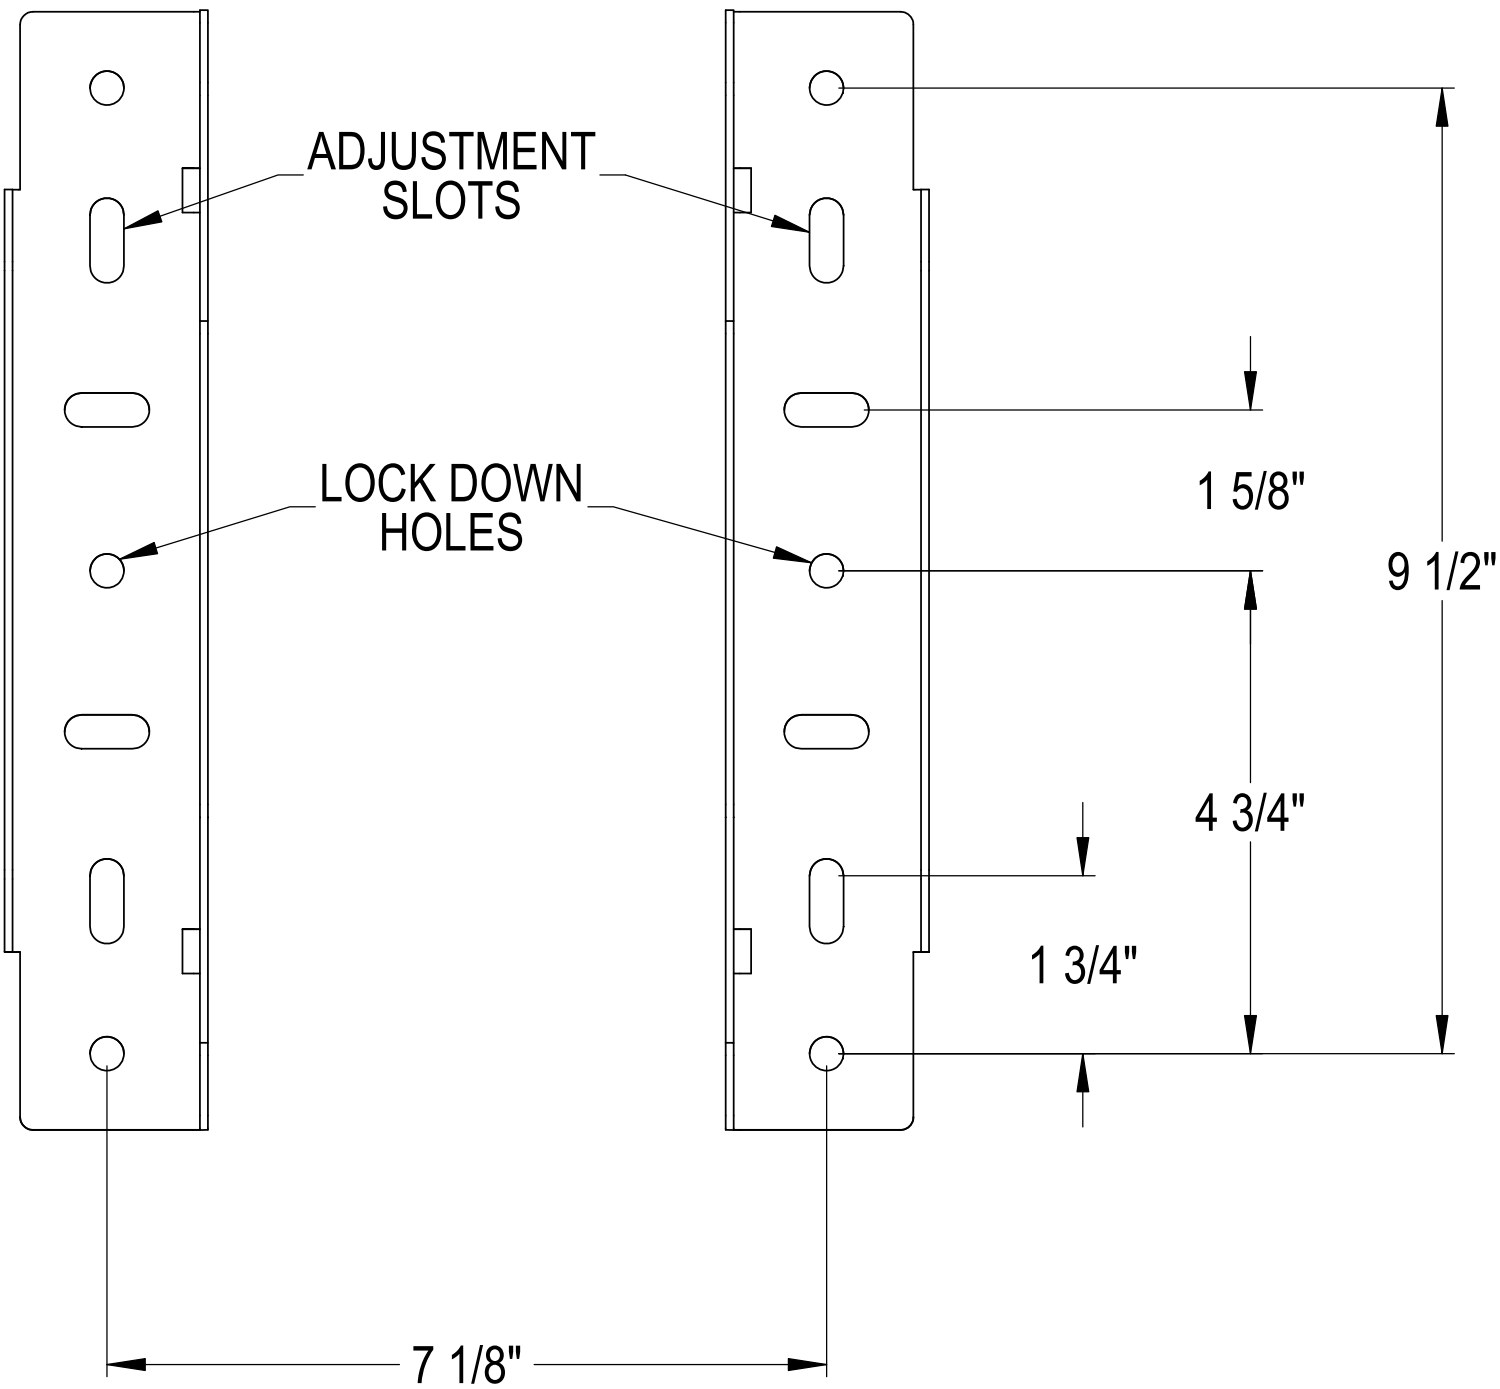

MOUNTING BRACKETS

ELECTRIC OPERATOR: LDJ (LIGHT DUTY)	
DOOR TYPE: ROLLING SHEET DOOR (DEAD SHAFT)	
MOUNTING TYPE: WALL MOUNT	
PROJECT:	
ARCHITECT:	
CONTRACTOR:	
DISTRIBUTOR:	
PLANT:	
DRAWN BY:	DATE:
APPROVED BY:	DATE:
DWG NO.	SHT ___ OF ___
ENG. CERT. NO.	
113310	

ARCHITECT DOOR NUMBER	QTY	FACTORY ORDER NUMBER	MOUNT TYPE	VOLTS	PHASE	CONTROL STATION		
			CHAIN COUPLE WALL MOUNT			3 BTN	KEY SWITCH	EXT. FLUSH 3 BUTTON