



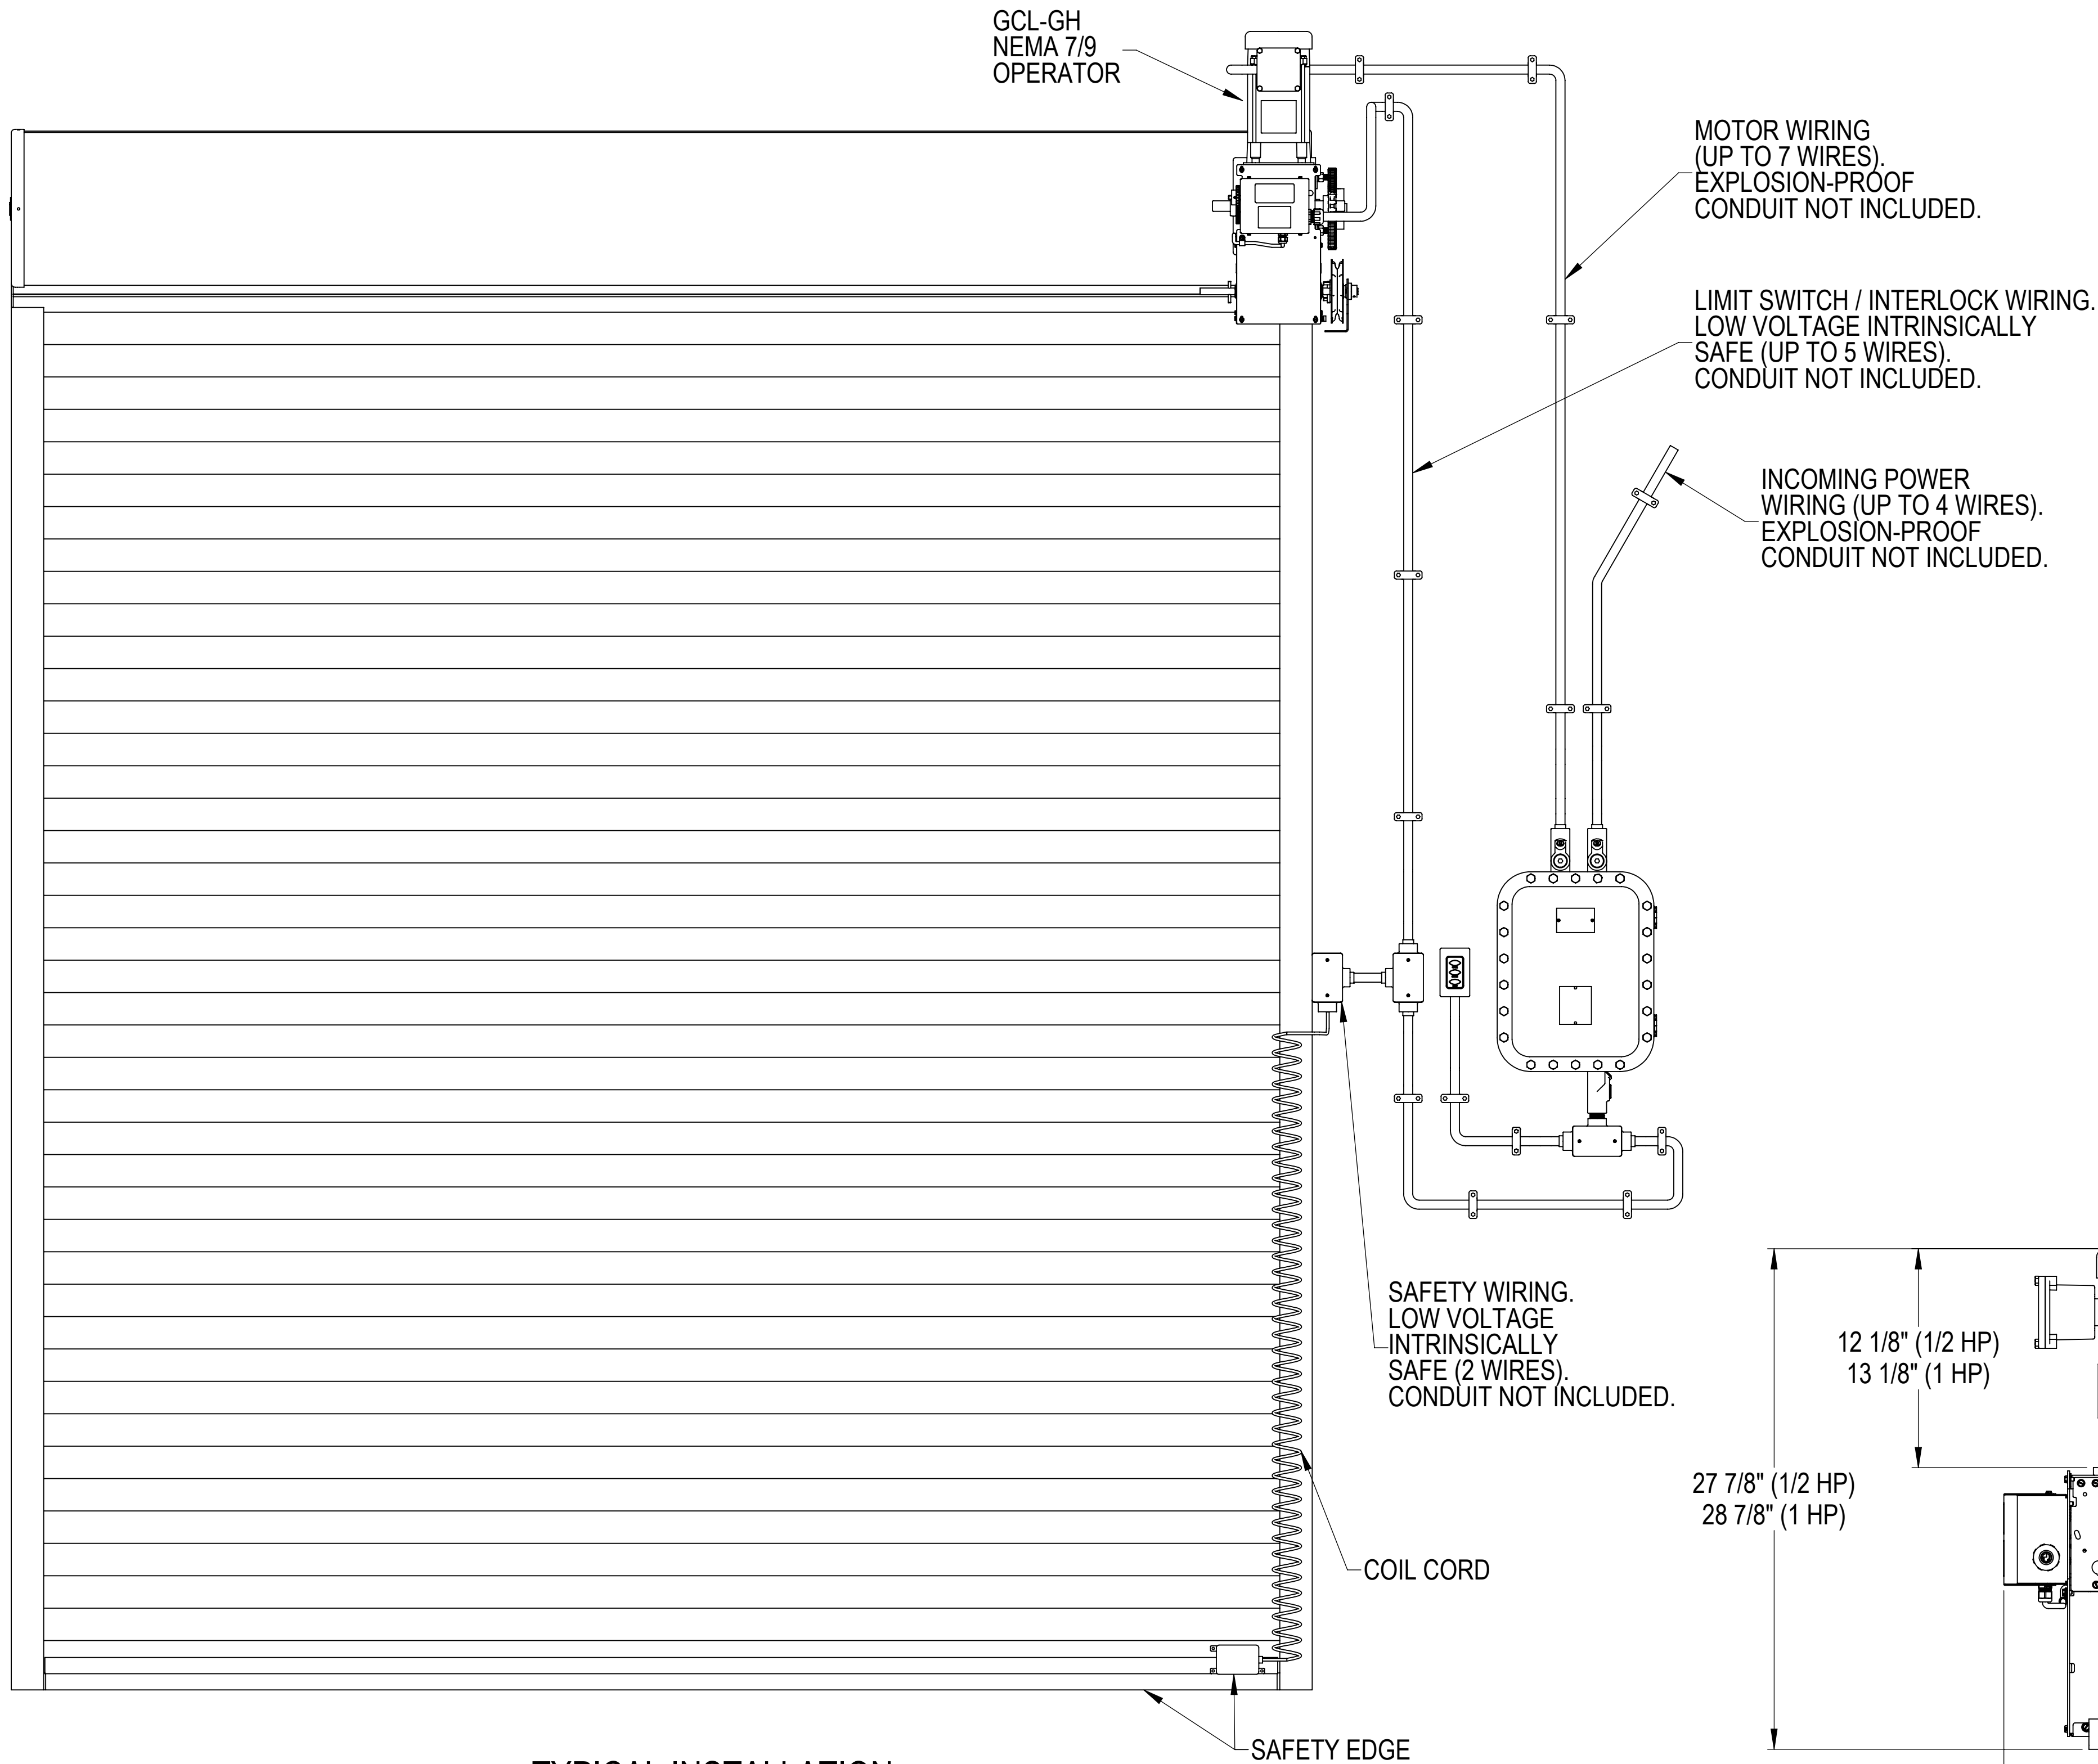


TYPICAL INSTALLATION

NOTES:

1. PLEASE VERIFY VOLTAGE, PHASE & MOUNTING.
2. ALL OPTIONS ARE AT ADDED COST.
3. WIRE SIZE TO BE DETERMINED BY A LICENSED ELECTRICIAN.
4. IT IS RECOMMENDED THAT THE OPERATOR BE BRACED TO THE WALL FOR STABILIZING AND A SAFETY CABLE ATTACHED.

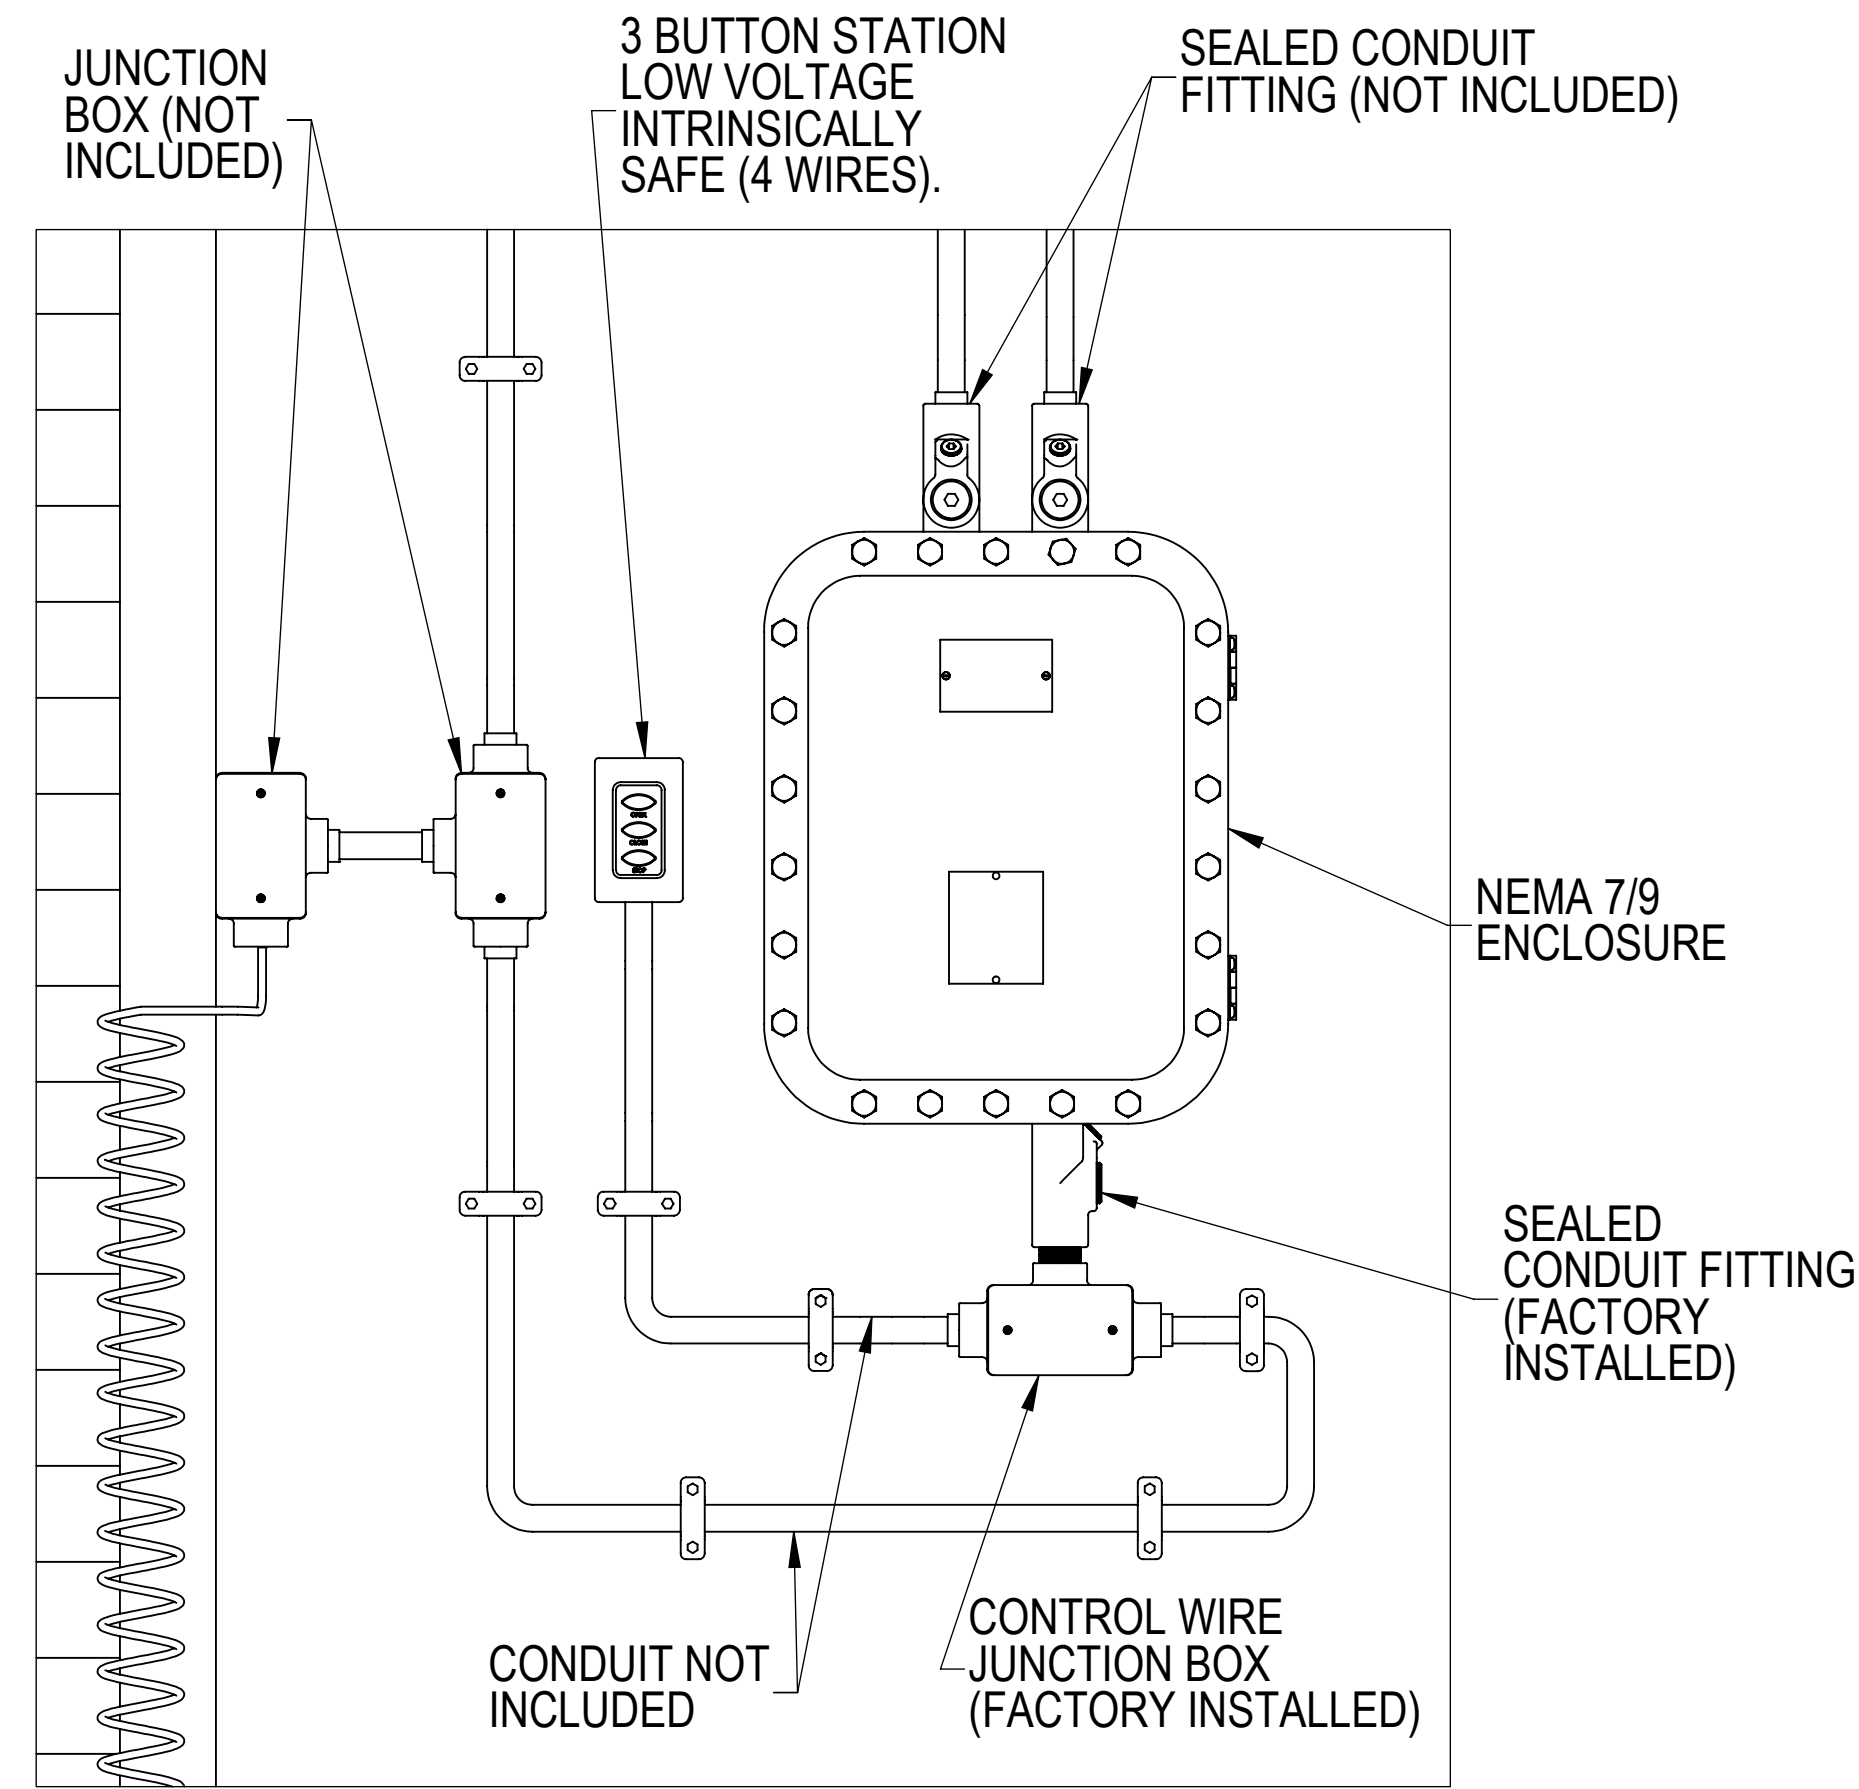

TYPICAL MOUNTING ARRANGEMENT

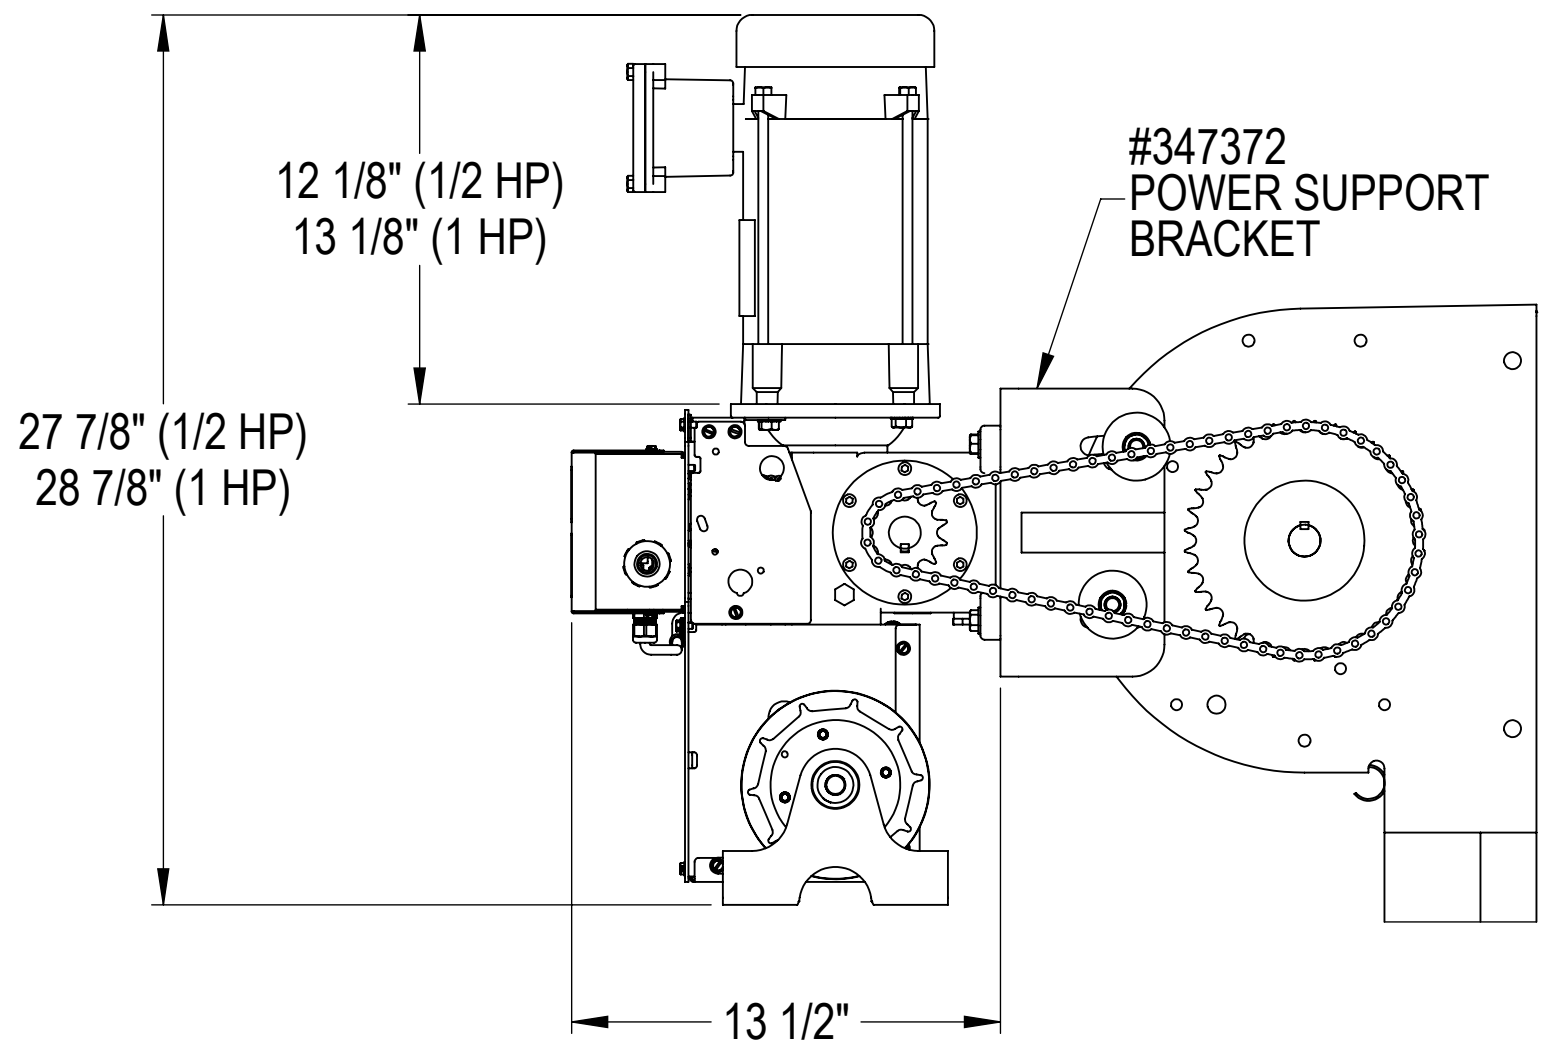

ARCHITECT DOOR NUMBER	QTY	FACTORY ORDER NUMBER	MOUNT TYPE	VOLTS				PHASE		CONTROL STATION		
			FRONT OF HOOD	115	208	230	460	1 PHASE	3 PHASE	3 BTN	KEY SWITCH	EXT. FLUSH 3 BUTTON

ELECTRIC OPERATOR: GCL-GH (NEMA 7/9) (1/2 & 1HP)	
DOOR TYPE:	ROLLING STEEL
MOUNTING TYPE:	FRONT OF HOOD
PROJECT:	
ARCHITECT:	
CONTRACTOR:	
DISTRIBUTOR:	
PLANT:	
DRAWN BY:	DATE:
APPROVED BY:	DATE:
DWG NO.	SHT ____ OF ____
ENG. CERT. NO.	

112707-0001

